



CHESTER P. VOISIN
President
JOHN PIZZOLATTO
Vice-President
CLIFTON J. STOUFFLET
Secretary

MICHAEL A. SOBERT
General Manager

P.O. Box 630 • Houma, LA 70361
Tel: (985) 879-2495 • Fax: (985) 879-2283
www.tpcw.org


STEPHEN HORNSBY
VINCENT CELESTIN
CHARLES BROWN, SR.
TERI CHATAGNIER
WILBERT THOMAS
KENNETH ELLENDER

CECILIA PRADO NORMAN
Chief Administrative Officer
Jacob Prosperie
Chief Engineer

January 5, 2021
BOIL WATER ADVISORY LIFTED
BWA 2022-01-01

Please be advised the Boil Water Advisory, BWA2022-01-01, for all residents of Ja Don Drive off Bayouside Drive in the Bourg area of Terrebonne Parish, 36, metered customers as shown on the attached map, has been lifted. The 1 sample, 218 Ja Don, collected and tested has shown that the water contains no harmful bacteria and that it is safe for human consumption. The test result is attached for your use and verification. It is no longer necessary to boil your water for 1 minute in a hard boil before consuming. The water is safe to drink

Please, like share and follow us on Facebook for notifications that affect your drinking water.

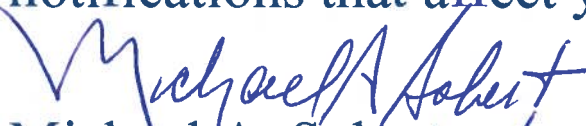
Michael A. Sobert 1/5/22
General Manager

Schriever Water Treatment Plant Service Area Boil Water Advisory Report for Tuesday, January 04, 2022

Sample Location ID 1109002	Date	Chlorine Residual mg/L	Colilert P/A	Turbidity NTU
218 Ja Don St	01-04-22	1.44	A	0.59

Line repair required reduced water pressure requiring a boil water advisory on Ja Don St.

Date: January 5, 2021


Ray Percle

Ray Percle
Lab Supervisor

UnderAdvisory

Status

- UnderAdvisory
- Structures

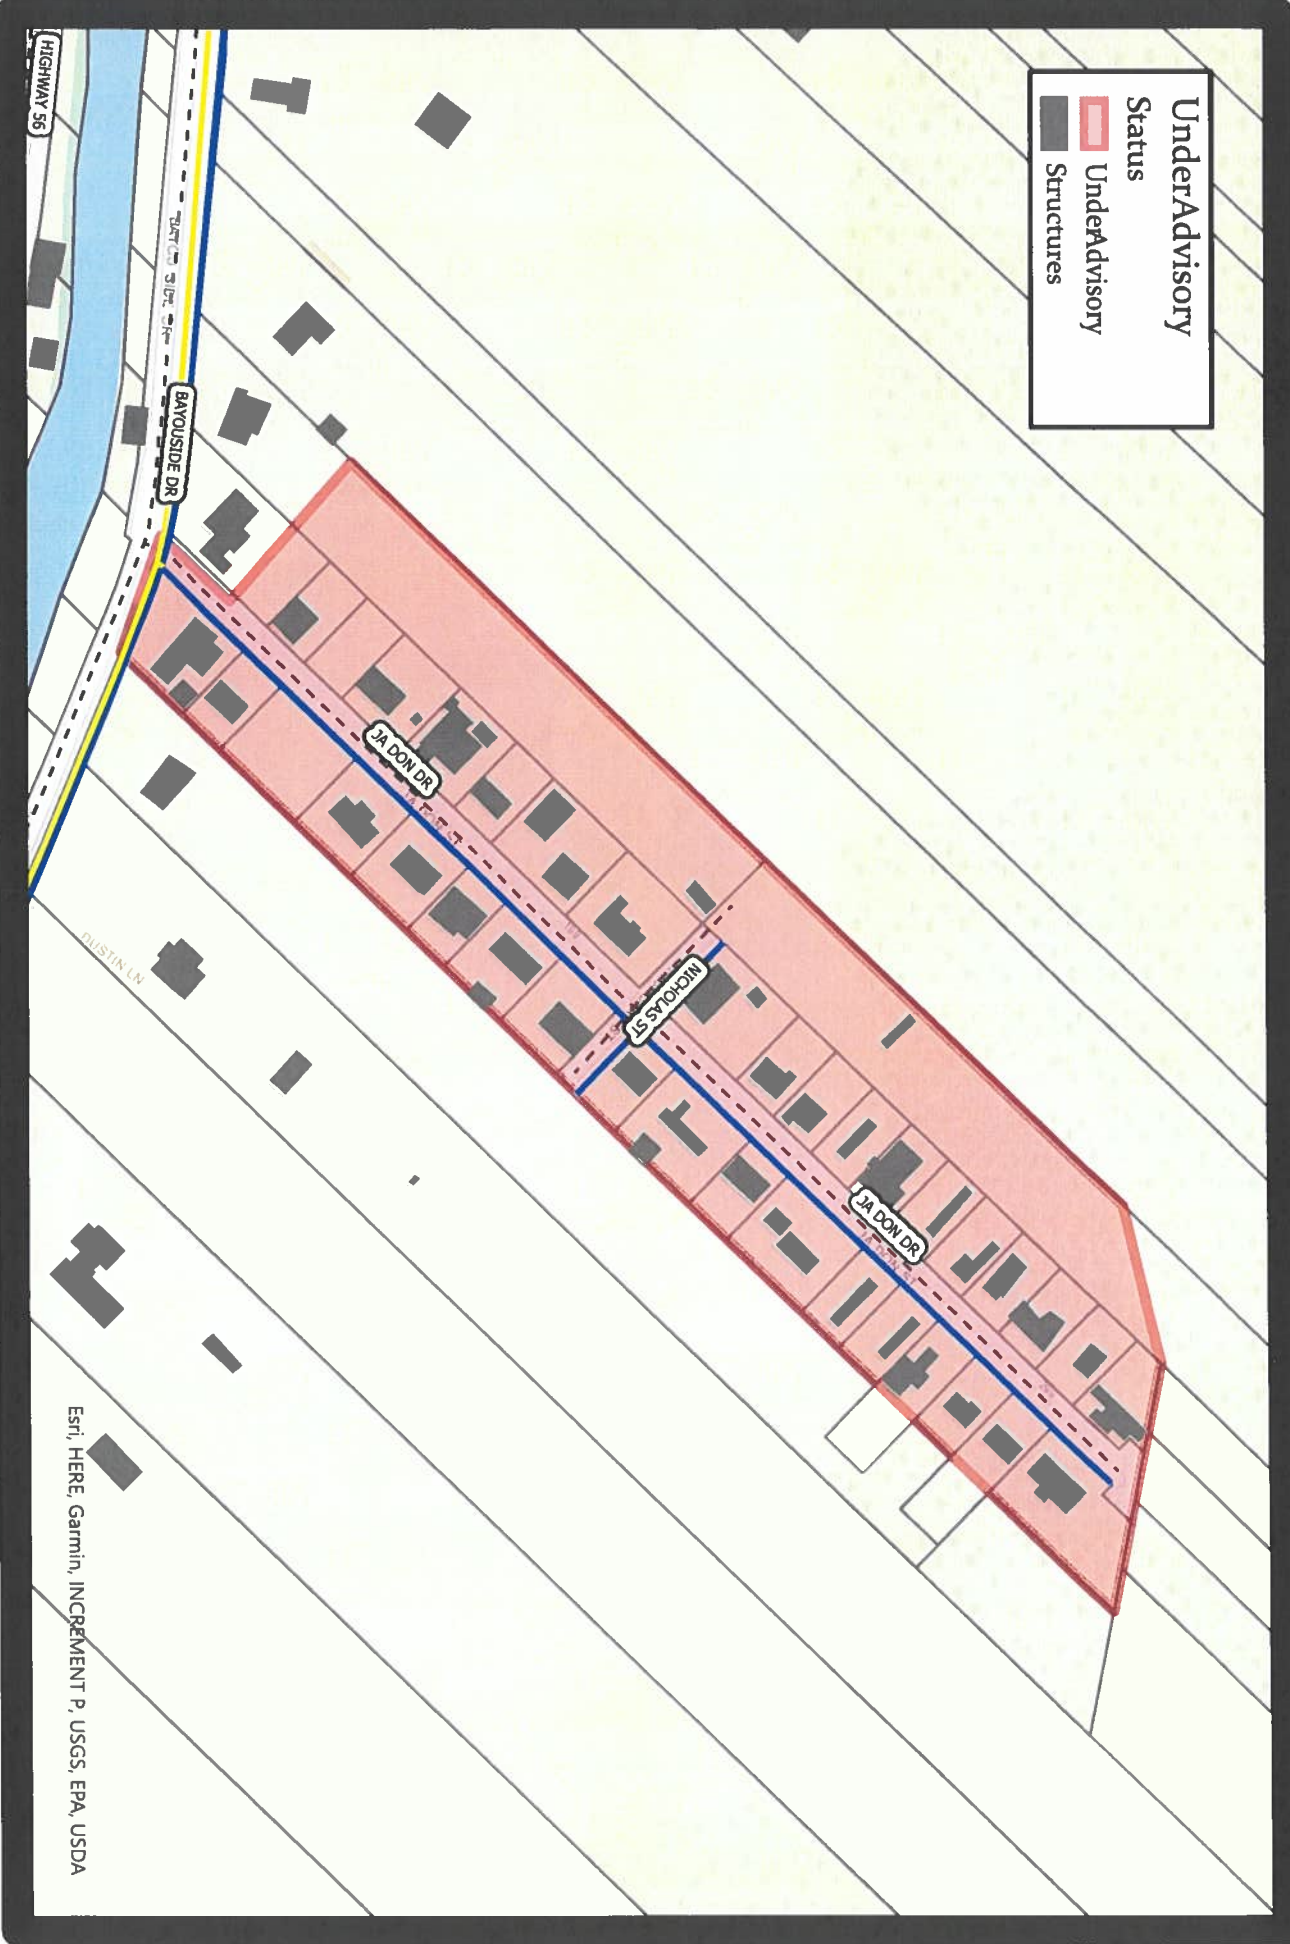

Esri, HERE, Garmin, INCREMENT P, USGS, EPA, USDA

Boil Water Advisory

EST. 36 CUSTOMERS

ALL OF JA DON DR WILL BE UNDER BOIL WATER ADVISORY.

JANUARY 4, 2022

BWA_2022_01-01

