



CHESTER P. VOISIN
President
JOHN PIZZOLATTO
Vice-President
CLIFTON J. STOUFFLET
Secretary

STEPHEN HORNSBY
VINCENT CELESTIN
CHARLES BROWN, SR.
TERI CHATAGNIER
WILBERT THOMAS
KENNETH ELLENDER

P.O. Box 630 • Houma, LA 70361
Tel: (985) 879-2495 • Fax: (985) 879-2283
www.tpcw.org

MICHAEL A. SOBERT
General Manager

CECILIA PRADO NORMAN
Chief Administrative Officer

BOIL WATER ADVISORY


April 21, 2022
BWA 2022-04-02


In accordance with the Louisiana Department of Health's Sanitary Code and out of an abundance of caution, 119 customers around 120 Tou Lou Street to 7345 Breakwater Dr in the Chauvin/Cocodrie Area off Hwy 56, are affected by this Boil Water Advisory. Please see the attached map for a more detailed graphic representation of the Boil Water Advisory area. Customers are advised to boil their water to a hard rolling boil for at least 1 minute prior to consumption. Please visit www.ldh.la.gov or www.tpcw.org for more specific detail information concerning what to do when a Boil Water Advisory has been issued.

This is due to a boring crew breaking the waterline.

Samples have been taken with results expected back as soon as possible.

Remember to boil your water in a hard rolling boil for at least 1 minute prior to human consumption. Please like, share, and follow us on Facebook for information concerning your drinking water supplier and the results of water quality sampling on testing of your water.


Michael A. Sobert
General Manager 4/21/22

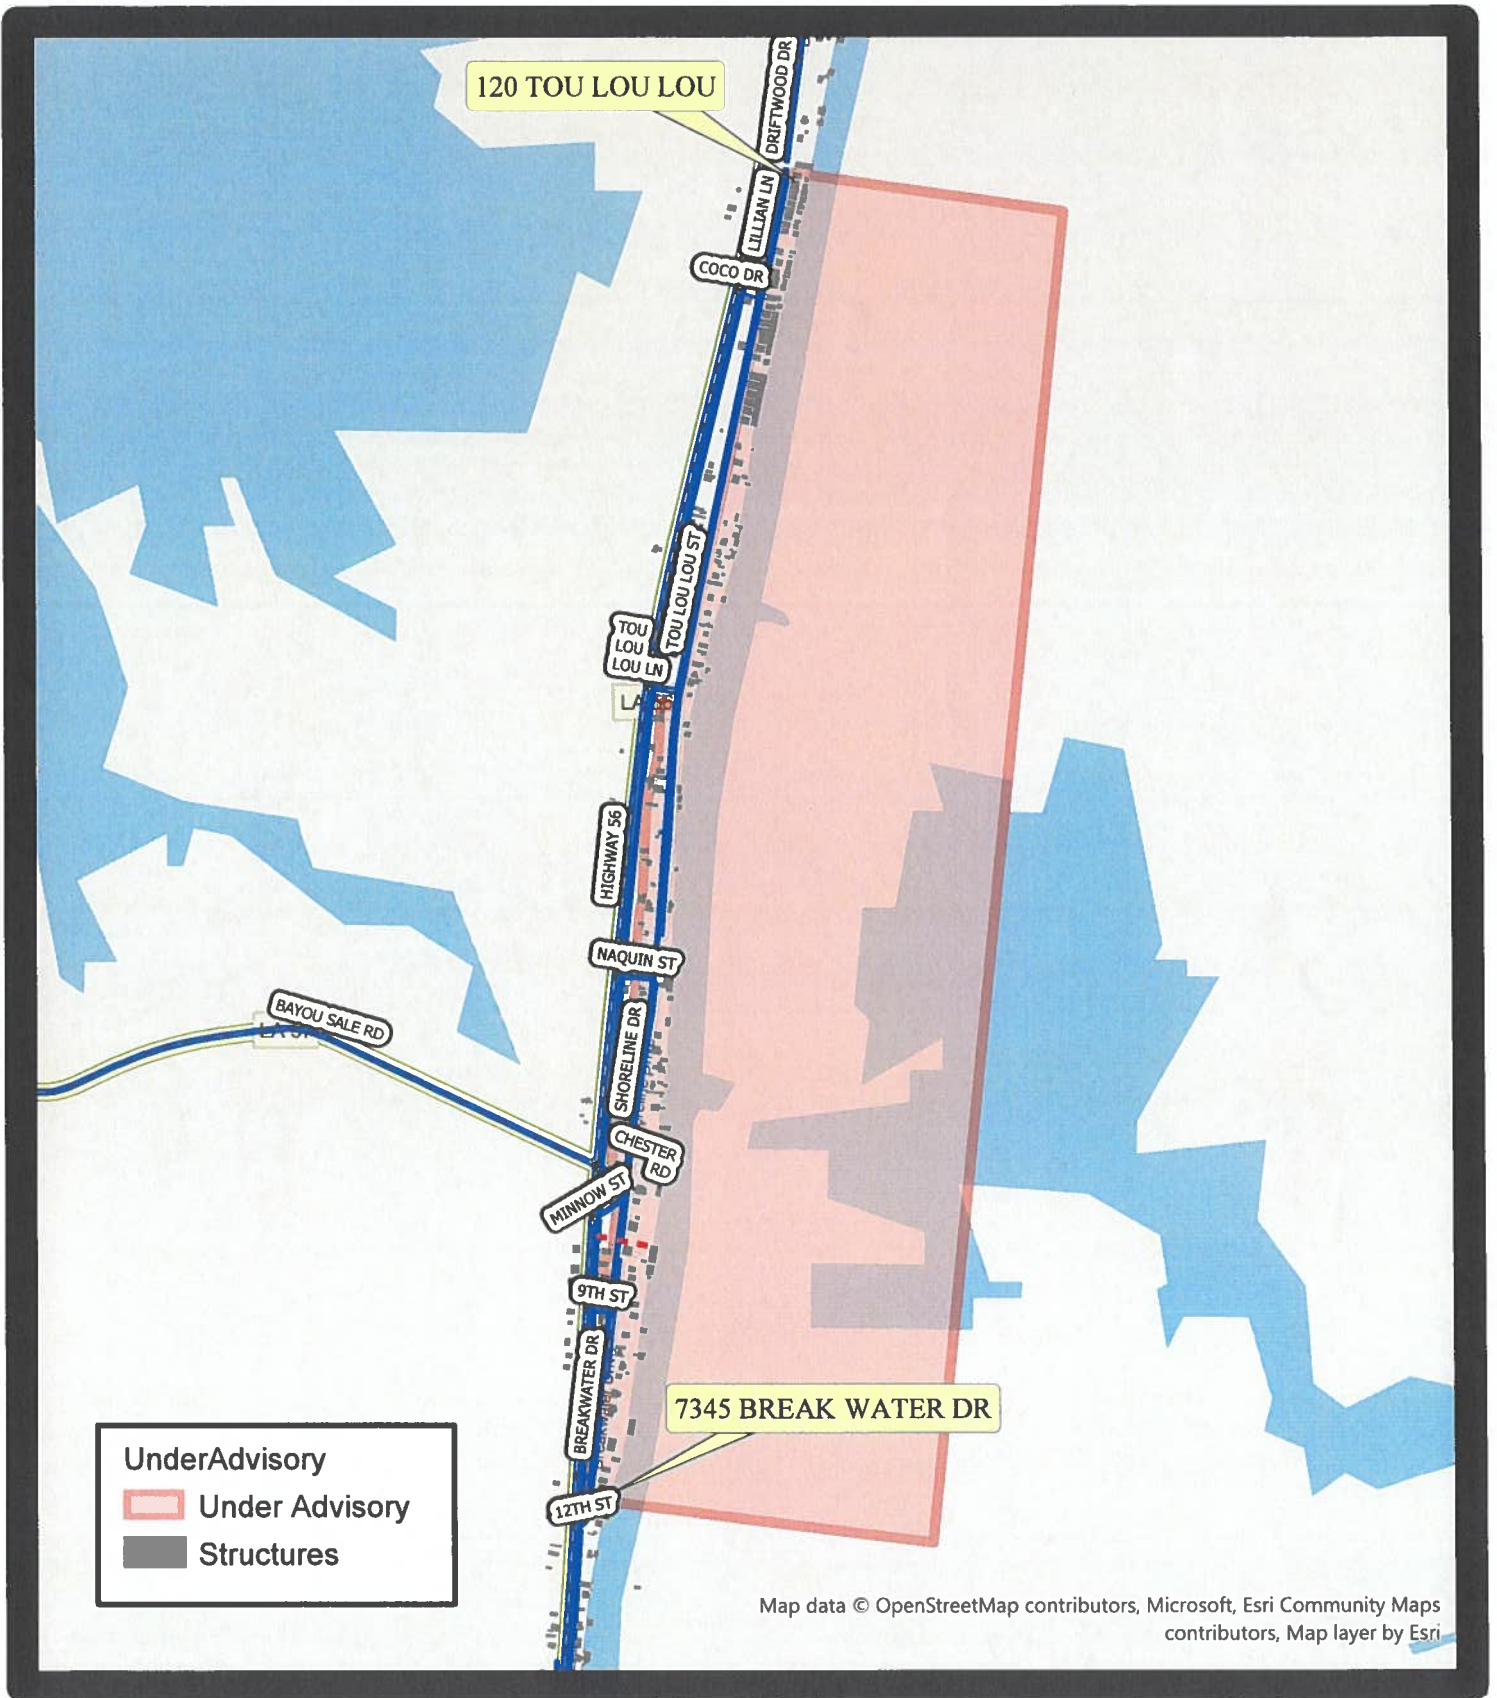

Boil Water Advisory

EST. 119 CUSTOMERS

120 TOU LOU LOU TO 7345 BREAK WATER DR

APRIL 21, 2022

BWA_2022-04-02

