



CHESTER P. VOISIN
President
JOHN PIZZOLATTO
Vice-President
CLIFTON J. STOUFFLET
Secretary

STEPHEN HORNSBY
VINCENT CELESTIN
CHARLES BROWN, SR.
TERI CHATAGNIER
WILBERT THOMAS
KENNETH ELLENDER

P.O. Box 630 • Houma, LA 70361
Tel: (985) 879-2495 • Fax: (985) 879-2283
www.tpcw.org


MICHAEL A. SOBERT
General Manager


CECILIA PRADO NORMAN
Chief Administrative Officer

April 22, 2022
BOIL WATER ADVISORY LIFTED
BWA 2022-04-01

Please be advised the Boil Water Advisory, BWA2022-04-02, affecting the 119 customers located between Tou Lou Street to Breakwater Drive in the Cocodrie/Chauvin area off Hwy 56 is LIFTED. The four samples taken, copy of results are attached, show no harmful bacteria present and proves that the water is safe for human consumption. It is no longer necessary to boil your water for 1 minute in a hard boil before consuming. The water is safe to drink.

Please, like share and follow us on Facebook for notifications that affect your drinking water.

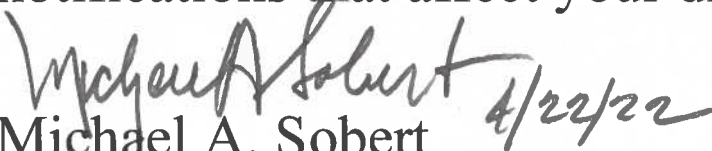
Michael A. Sobert
General Manger

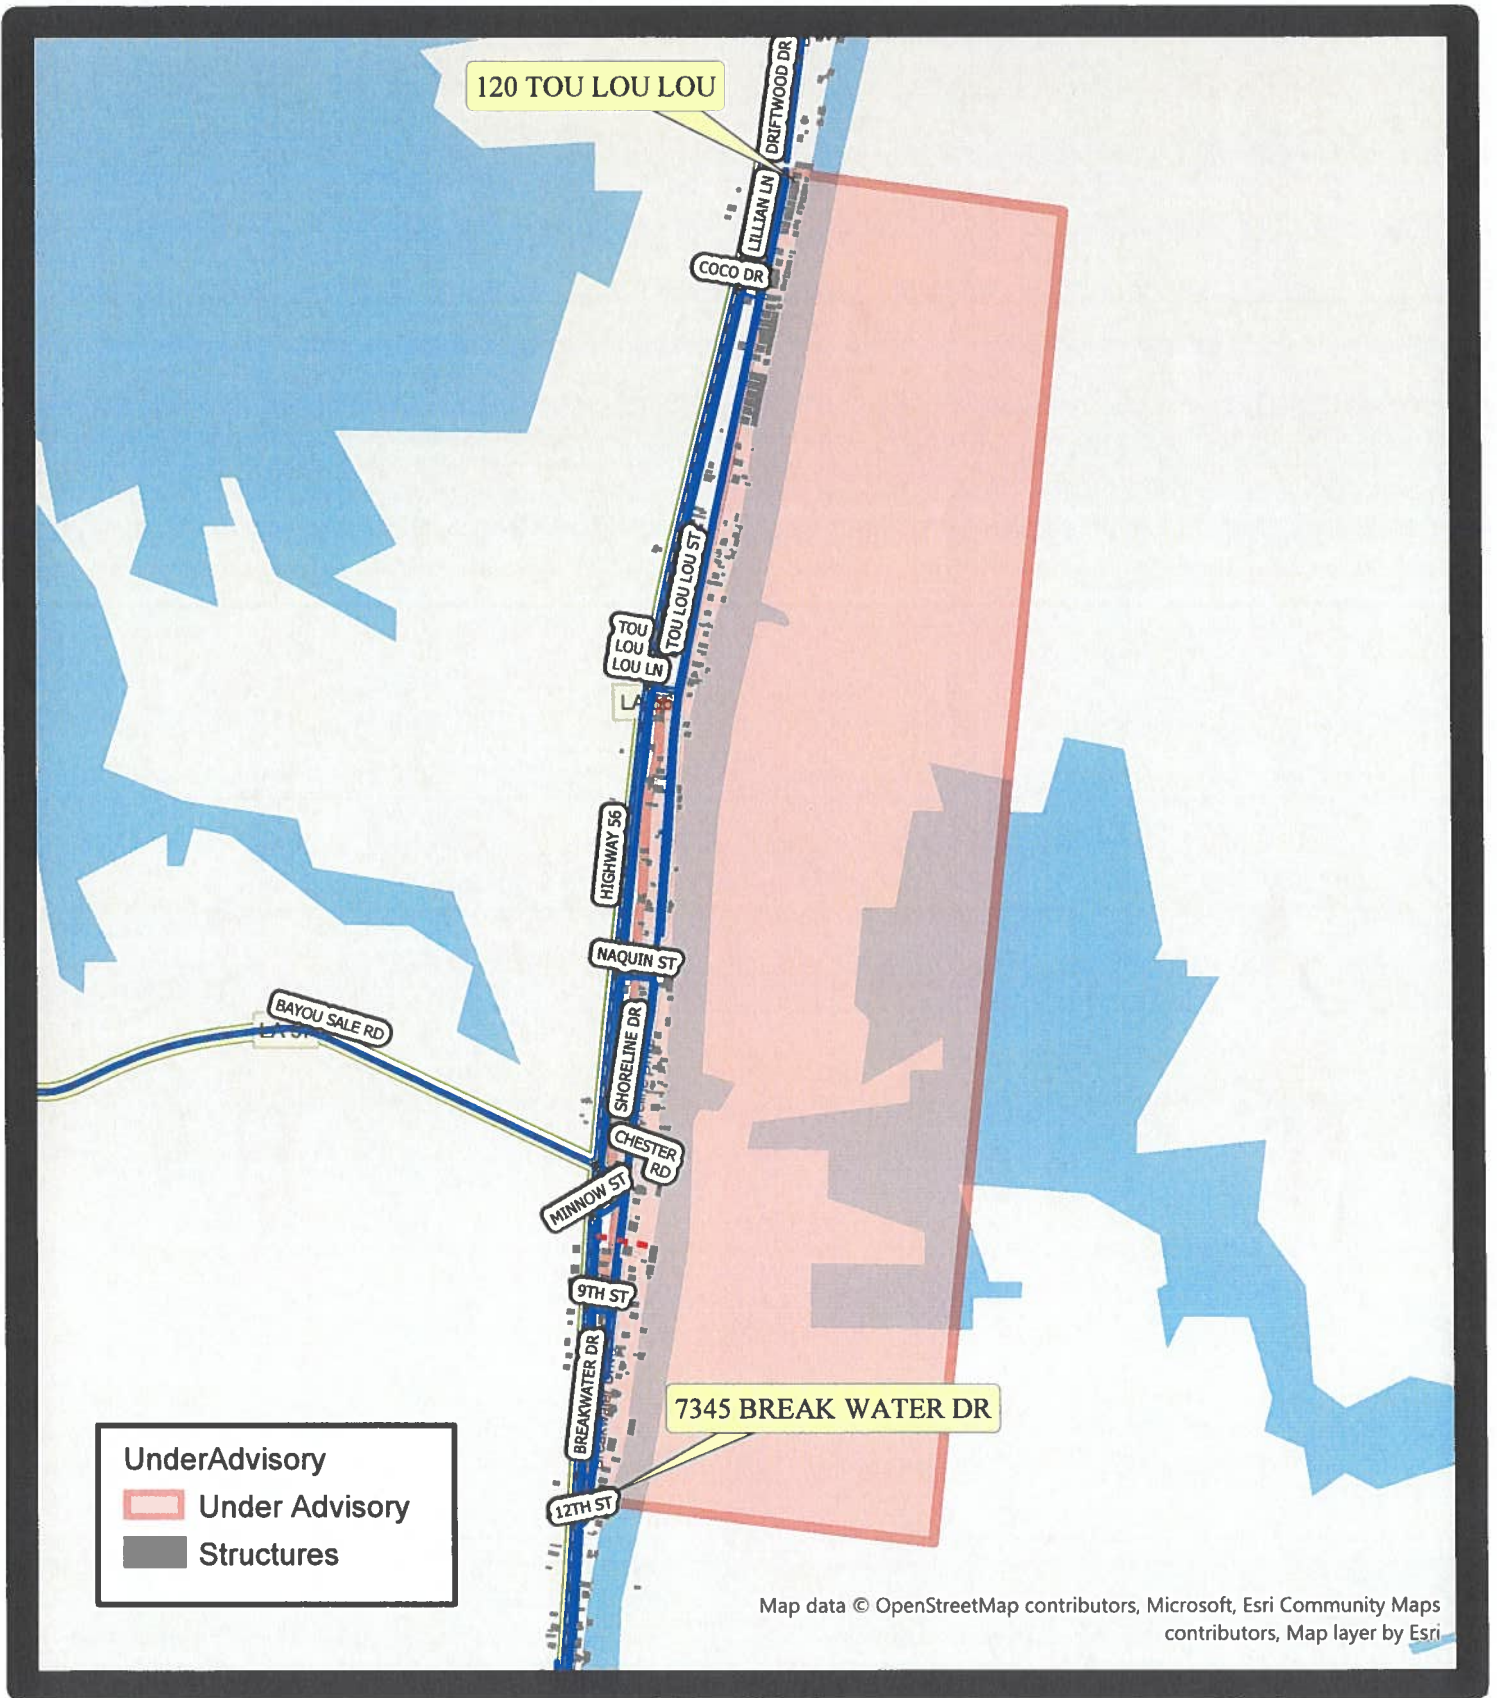

Boil Water Advisory

EST. 119 CUSTOMERS

120 TOU LOU LOU TO 7345 BREAK WATER DR

APRIL 21, 2022

BWA_2022-04-02



Schriever Water Treatment Plant Service Area Boil Water Advisory Report for Thursday, April 21, 2022

Sample Location ID 1109002	Date	Chlorine Residual mg/L	Colilert P/A	Turbidity NTU
7250 Tou Lou Lou St	04-21-22	1.46	A	
7236 Shoreline Dr	04-21-22	1.39	A	
7345 Break Water Dr	04-21-22	1.20	A	
7056 Tou Lou Lou St	04-21-22	1.75	A	

Boring contractor damaged waterline.

Date: 4-22-2022

Ray Percle

Ray Percle
Lab Supervisor