



CHESTER P. VOISIN  
*President*  
JOHN PIZZOLATTO  
*Vice-President*  
CLIFTON J. STOUFFLET  
*Secretary*

STEPHEN HORNSBY  
VINCENT CELESTIN  
CHARLES BROWN, SR.  
TERI CHATAGNIER  
WILBERT THOMAS  
KENNETH ELLENDER

P.O. Box 630 • Houma, LA 70361  
Tel: (985) 879-2495 • Fax: (985) 879-2283  
[www.tpcw.org](http://www.tpcw.org)

MICHAEL A. SOBERT  
*General Manager*

CECILIA PRADO NORMAN  
*Chief Administrative Officer*

JACOB PROSPERIE  
*Chief*


January 21, 2022  
**BOIL WATER ADVISORY LIFTED**  
**BWA 2022-1-04**

Please be advised the Boil Water Advisory, BWA2022-01-04, for the Bourg, Dunn Street area of Houma area, 10 metered customers as shown on the attached map, of Terrebonne Parish has been lifted. The two samples that were collected and tested have shown that the water contains no harmful bacteria and that it is safe for human consumption. The test results are attached for your use and verification. It is no longer necessary to boil your water for 1 minute in a hard boil before consuming. The water is safe to drink

Please, like share and follow us on Facebook for notifications that affect your drinking water.

  
Michael A. Sobert  
General Manager

1/21/22

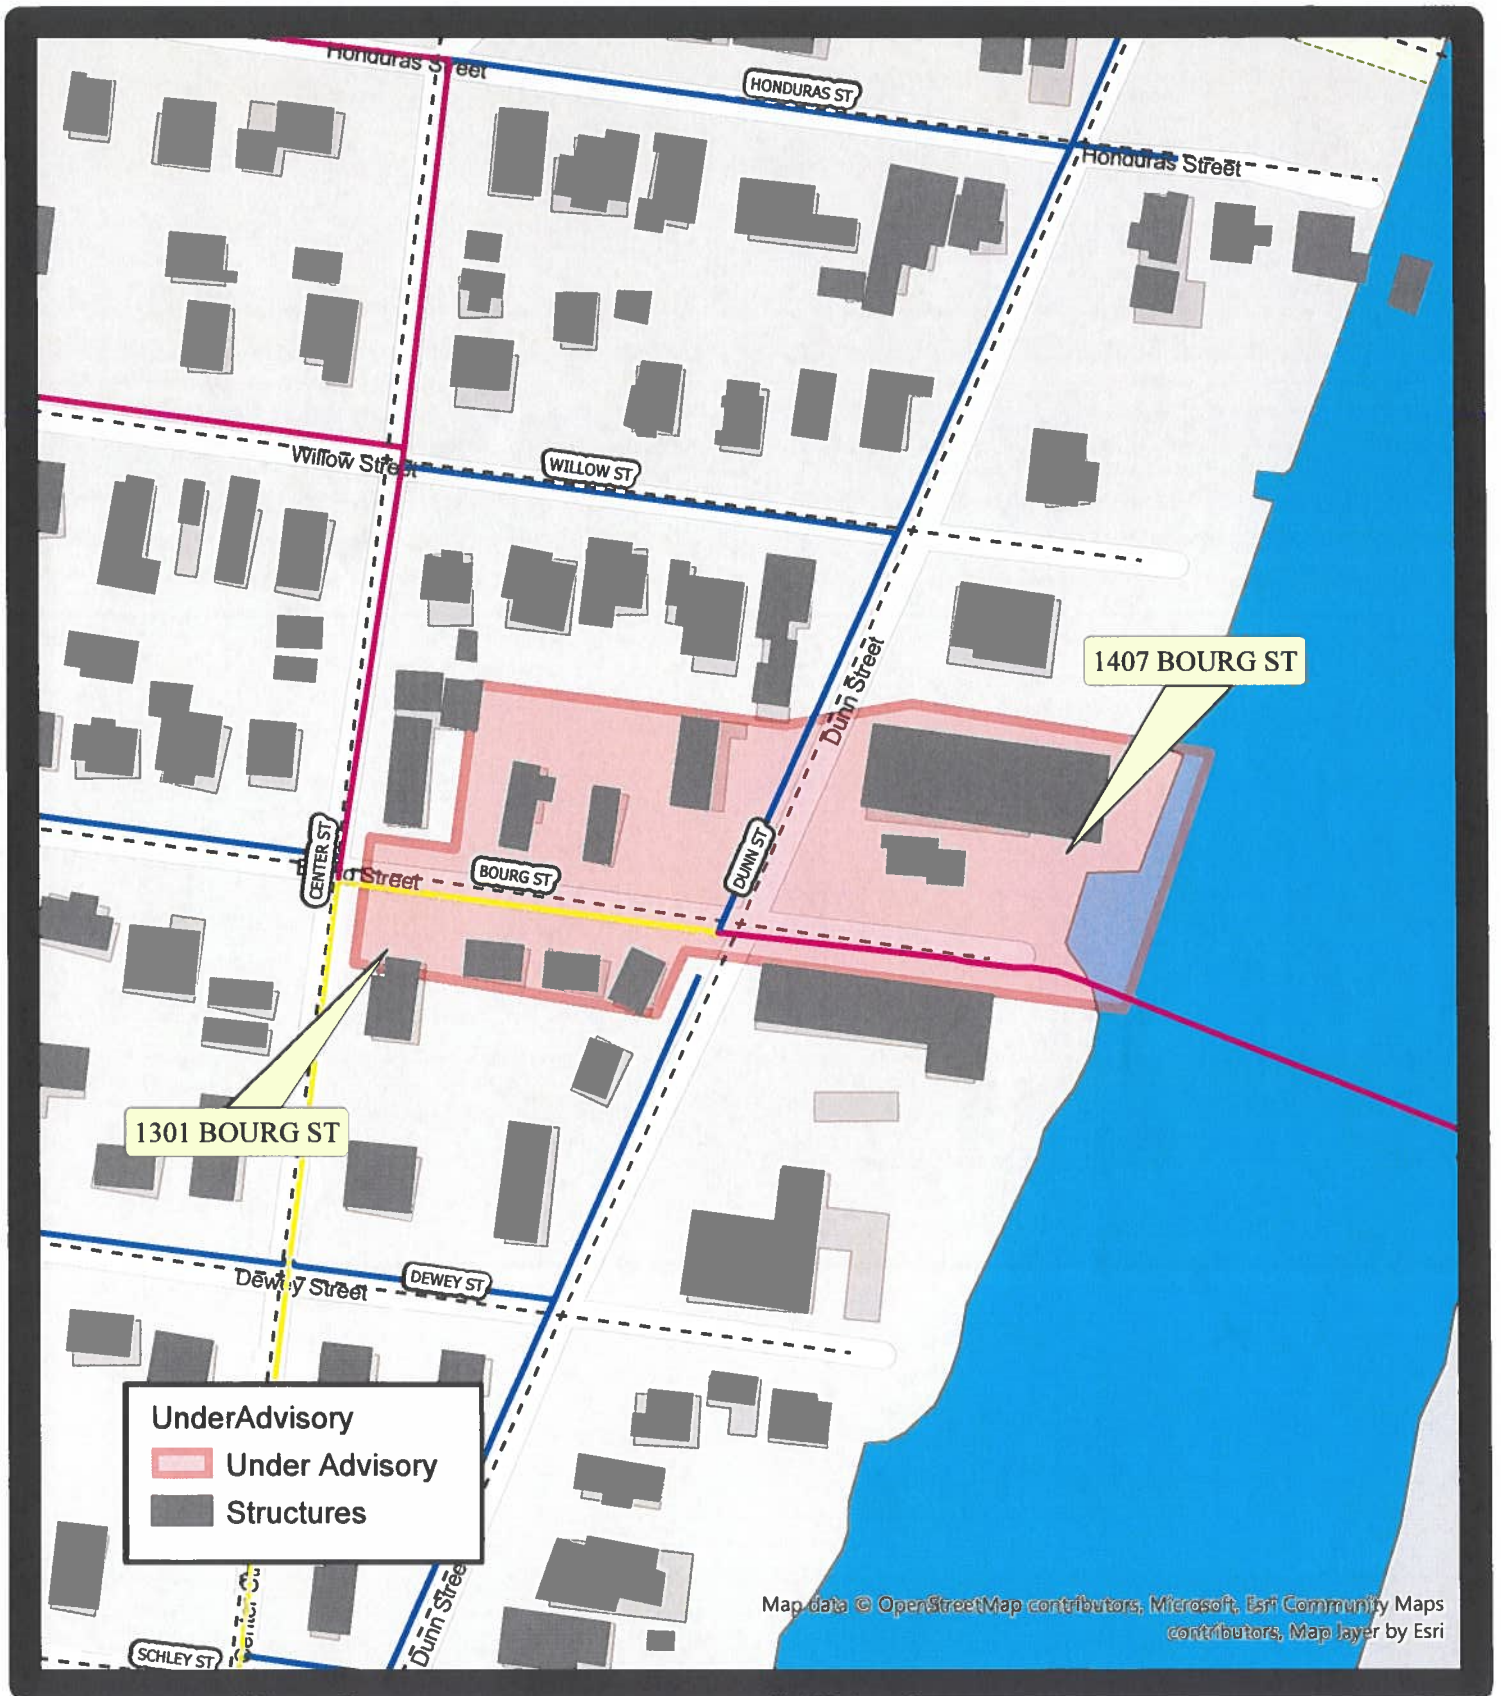

**Boil Water Advisory**

**EST. 10 CUSTOMERS**

**1301 BOURG ST TO 1407 BOURG ST**

**JANUARY 20, 2022**

BWA-2022-01-04



# Schriever Water Treatment Plant Service Area Boil Water Advisory Report for Thursday, January 20, 2022

Sample Location ID 1109002	Date	Chlorine Residual mg/L	Colilert P/A	Turbidity NTU
1400 Dunn St	01-20-22	3.50	A	0.94
1304 Bourg St	01-20-22	3.40	A	0.66

BWA-1301 Bourg St to 1407 Bourg St. Valve repair on GIW crossing.

Date: January 20, 2022

*Ray Percle*

**Ray Percle  
Lab Supervisor**