



CHESTER P. VOISIN  
*President*  
JOHN PIZZOLATTO  
*Vice-President*  
CLIFTON J. STOUFFLET  
*Secretary*

MICHAEL A. SOBERT  
*General Manager*

P.O. Box 630 • Houma, LA 70361  
Tel: (985) 879-2495 • Fax: (985) 879-2283  
[www.tpcw.org](http://www.tpcw.org)

STEPHEN HORNSBY  
VINCENT CELESTIN  
CHARLES BROWN, SR.  
TERI CHATAGNIER  
WILBERT THOMAS  
KENNETH ELLENDER


CECILIA PRADO NORMAN  
*Chief Administrative Officer*


*Jacob Prosperie*  
*Chief Engineer*

August 23, 2022  
**BOIL WATER ADVISORY LIFTED**  
**BWA 2022-08-02**

Please be advised the Boil Water Advisory, BWA2022-08-02, affecting the 87 metered customers located from 601 to 605 Main Project Rd. and 443 to 605 Main Project Rd in the Schriever Area of Terrebonne Parish is LIFTED. The 4 samples taken, copy of certified lab results are attached, show no harmful bacteria present and proves that the water is safe for human consumption. It is no longer necessary to boil your water for 1 minute in a hard boil before consuming. The water is safe to drink

Please, like share and follow us on Facebook for notifications that affect your drinking water. Check out our NEW Website at [www.tpcw.org](http://www.tpcw.org) for additional information or pay your water bill online.


  
Michael A. Sobert  
General Manager 8/23/22

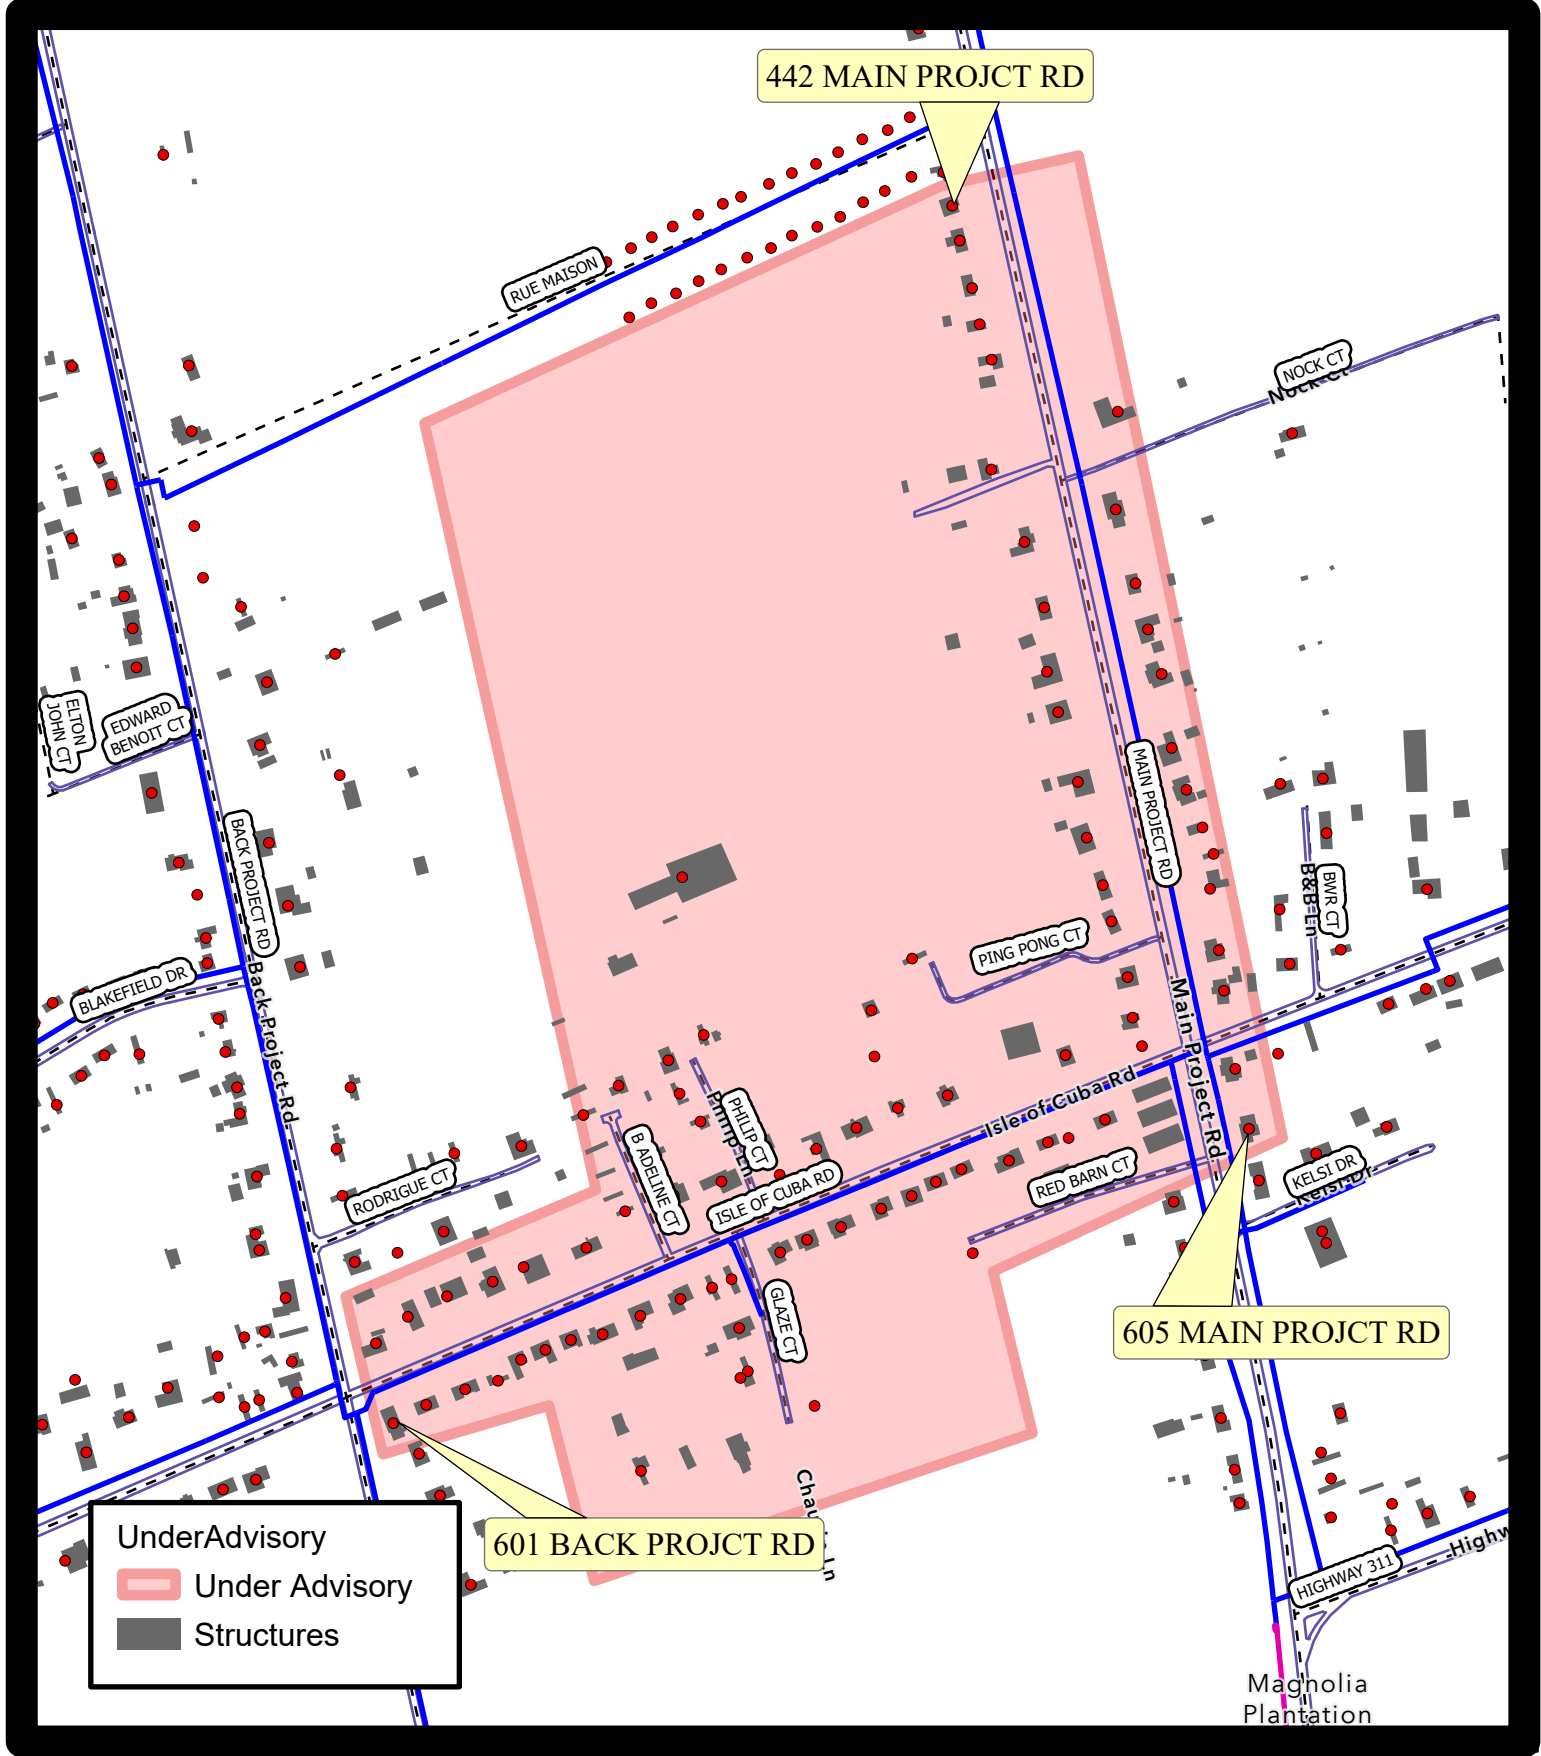

**Boil Water Advisory**

**EST. 87 CUSTOMERS**

ALONG ISLE OF CUBA RD FROM  
 601 BACK PROJECT RD TO 605 MAIN PROJECT RD  
 ALONG MAIN PROJECT RD FROM  
 442 MAIN PROJECT RD TO 605 MAIN PROJECT RD



**AUGUST 22, 2022**

BWA\_2022-08-02

# Schriever Water Treatment Plant Service Area Boil Water Advisory Report for Monday, August 22, 2022

Sample Location ID 1109002	Date	Chlorine Residual mg/L	Colilert P/A	Turbidity NTU
227 Isle of Cuba Rd	08-22-22	3.60	A	0.74
235 Isle of Cuba Rd	08-22-22	2.90	A	0.91
444 Main Project Rd	08-22-22	2.60	A	1.03
512 Main Project Rd	08-22-22	3.10	A	0.68

BWA-water valved off for line repair.

Date: 8-22-22

*Ray Percle*

Ray Percle  
Lab Supervisor