

Schriever Water Treatment Plant Service Area Boil Water Advisory Report for Wednesday, August 31, 2022

Sample Location ID 1109002	Date	Chlorine Residual mg/L	Colilert P/A	Turbidity NTU
202 Myra St	08-31-22	1.48	A	0.82
124 Judith ST	08-31-22	1.31	A	1.32
300 Rudy ST	08-31-22	.75	A	3.02
111 Jane St	08-31-22	.90	A	4.12


BWA-Line repair required valving off water to area after line was damage by contractor replacing a culvert.

Date: 9-1-2022



Ray Percle
Lab Supervisor

UnderAdvisory
Under Advisory

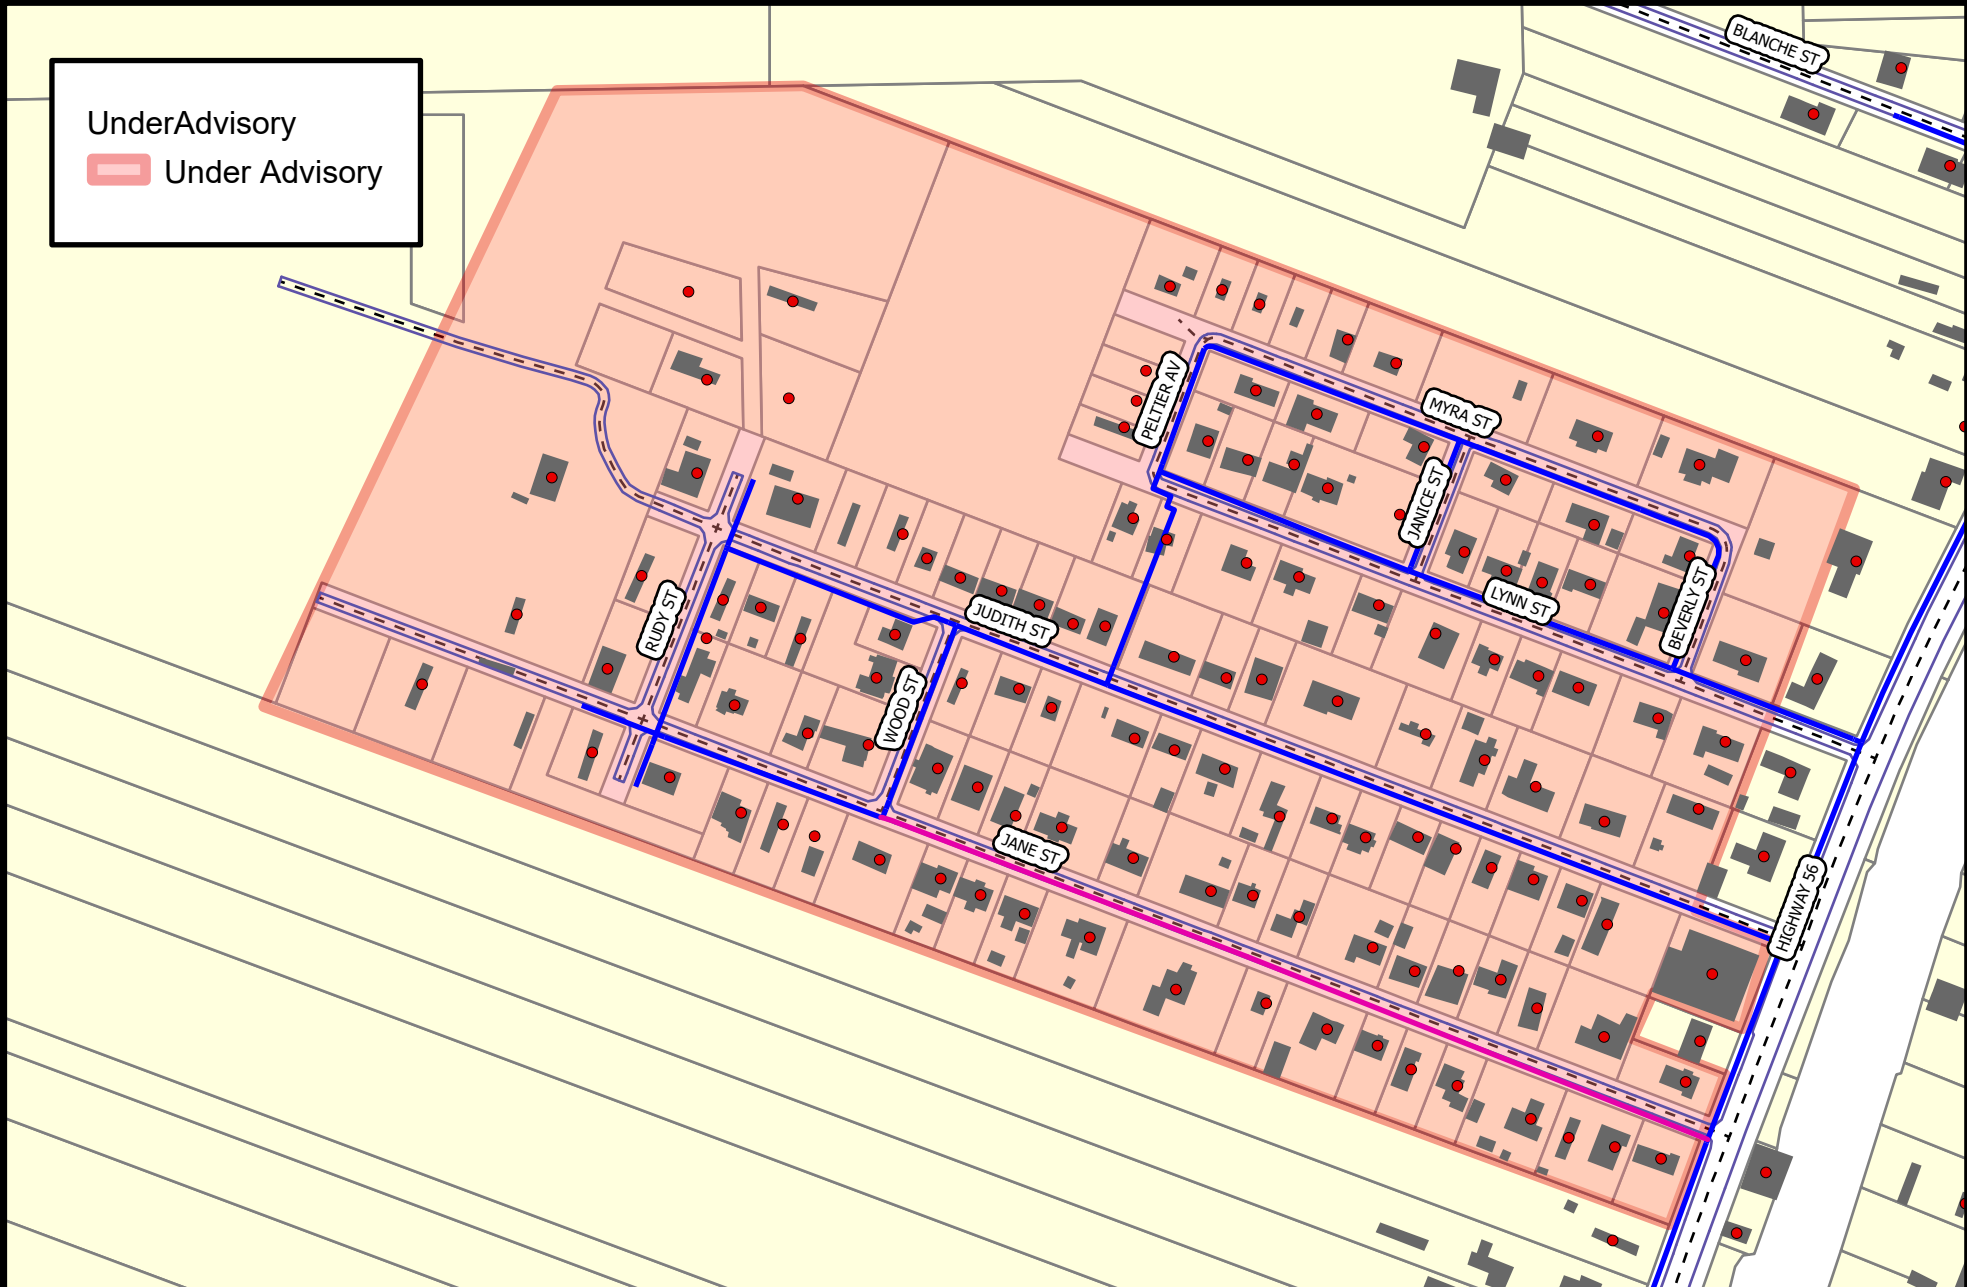

Boil Water Advisory

ALL OF JANE ST, JUDITH ST, LYNN ST,
MYRA ST, RUDY ST, WOOD ST,
BERVERLY ST, JANICE ST, AND PELTIER AVE

AUGUST 29, 2022

EST. 125 CUSTOMERS

BWA_2022-08-04

