



CHESTER P. VOISIN  
*President*  
JOHN PIZZOLATTO  
*Vice-President*  
CLIFTON J. STOUFFLET  
*Secretary*

STEPHEN HORNSBY  
VINCENT CELESTIN  
CHARLES BROWN, SR.  
TERI CHATAGNIER  
WILBERT THOMAS  
KENNETH ELLENDER

P.O. Box 630 • Houma, LA 70361  
Tel: (985) 879-2495 • Fax: (985) 879-2283

[www.tpcw.org](http://www.tpcw.org)

MICHAEL A. SOBERT  
*General Manager*

CECILIA PRADO NORMAN  
*Chief Administrative Officer*


*Jacob Prosperie*  
*Chief Engineer*

October 4, 2022  
**BOIL WATER ADVISORY LIFTED**  
**BWA 2022-10-01**

Please be advised the Boil Water Advisory, BWA2022-10-01, affecting the 34 metered customers located at 4157 to 4204 Bayouside Drive in the Chauvin Area of Terrebonne Parish is LIFTED. The ? samples taken, copy of certified lab results are attached, show no harmful bacteria present and proves that the water is safe for human consumption. It is no longer necessary to boil your water for 1 minute in a hard boil before consuming. The water is safe to drink

Please, like share and follow us on Facebook for notifications that affect your drinking water. Check out our NEW Website at [www.tpcw.org](http://www.tpcw.org) for additional information or pay your water bill online.

Michael A. Sobert  
General Manger

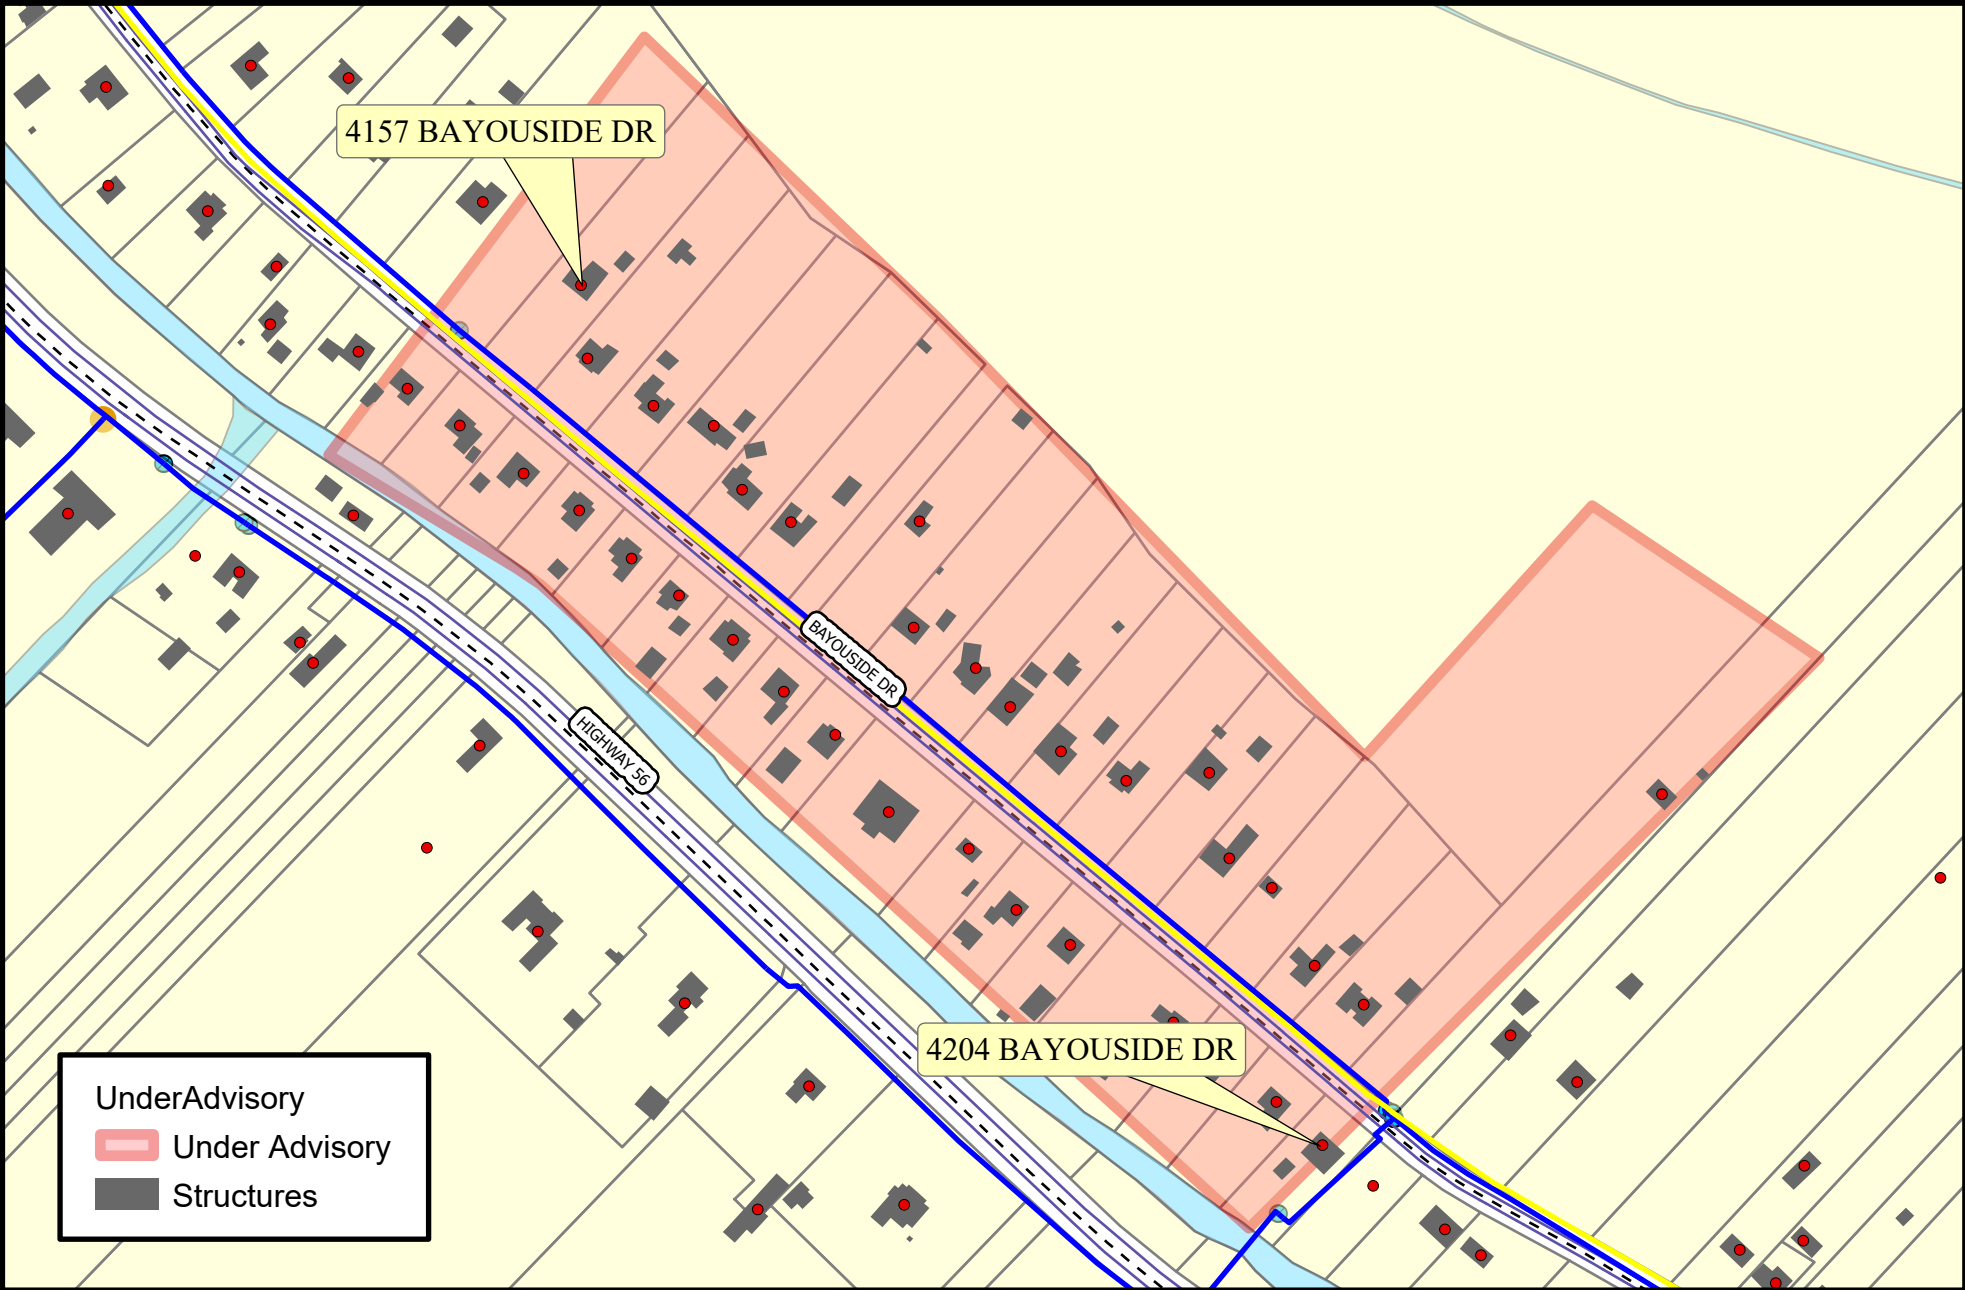


# Boil Water Advisory

ALL CUSTOMERS FROM  
4157 BAYOUSIDE DR TO 4204 BAYOUSIDE DR

**OCTOBER 3, 2022**

**EST. 34 CUSTOMERS**

BWA-2022-10-01



# Schriever Water Treatment Plant Service Area Boil Water Advisory Report for Monday, October 03, 2022

Sample Location ID 1109002	Date	Chlorine Residual mg/L	Colilert P/A	Turbidity NTU
4162 Bayouside Dr	10-03-22	2.10	A	2.15
4181 Bayouside Drive; POC 139	10-03-22	2.30	A	1.31
4201 bayouside Dr	10-03-22	2.00	A	0.68

BWA- contractor bored through water main requiring water to be closed for repair clamp.

Date: 10-4-2022

*Ray Percle*

Ray Percle  
Lab Supervisor