



CHESTER P. VOISIN
President
JOHN PIZZOLATTO
Vice-President
CLIFTON J. STOUFFLET
Secretary

STEPHEN HORNSBY
VINCENT CELESTIN
CHARLES BROWN, SR.
TERI CHATAGNIER
WILBERT THOMAS
KENNETH ELLENDER

P.O. Box 630 • Houma, LA 70361
Tel: (985) 879-2495 • Fax: (985) 879-2283

www.tpcw.org

MICHAEL A. SOBERT
General Manager

CECILIA PRADO NORMAN
Chief Administrative Officer


Jacob Prosperie
Chief Engineer

October 27, 2022
BOIL WATER ADVISORY LIFTED
BWA 2022-10-04

Please be advised the Boil Water Advisory, BWA2022-10-04, affecting the 711 metered customers located at 1115 Highway 55 to the end of the road including all of Montegut and Crochetville Area of Terrebonne Parish is LIFTED. The 6 samples taken, copy of certified lab results are attached, show no harmful bacteria present and proves that the water is safe for human consumption. It is no longer necessary to boil your water for 1 minute in a hard boil before consuming. The water is safe to drink

Please, like share and follow us on Facebook for notifications that affect your drinking water. Check out our NEW Website at www.tpcw.org for additional information or pay your water bill online.


Michael A. Sobert
General Manger

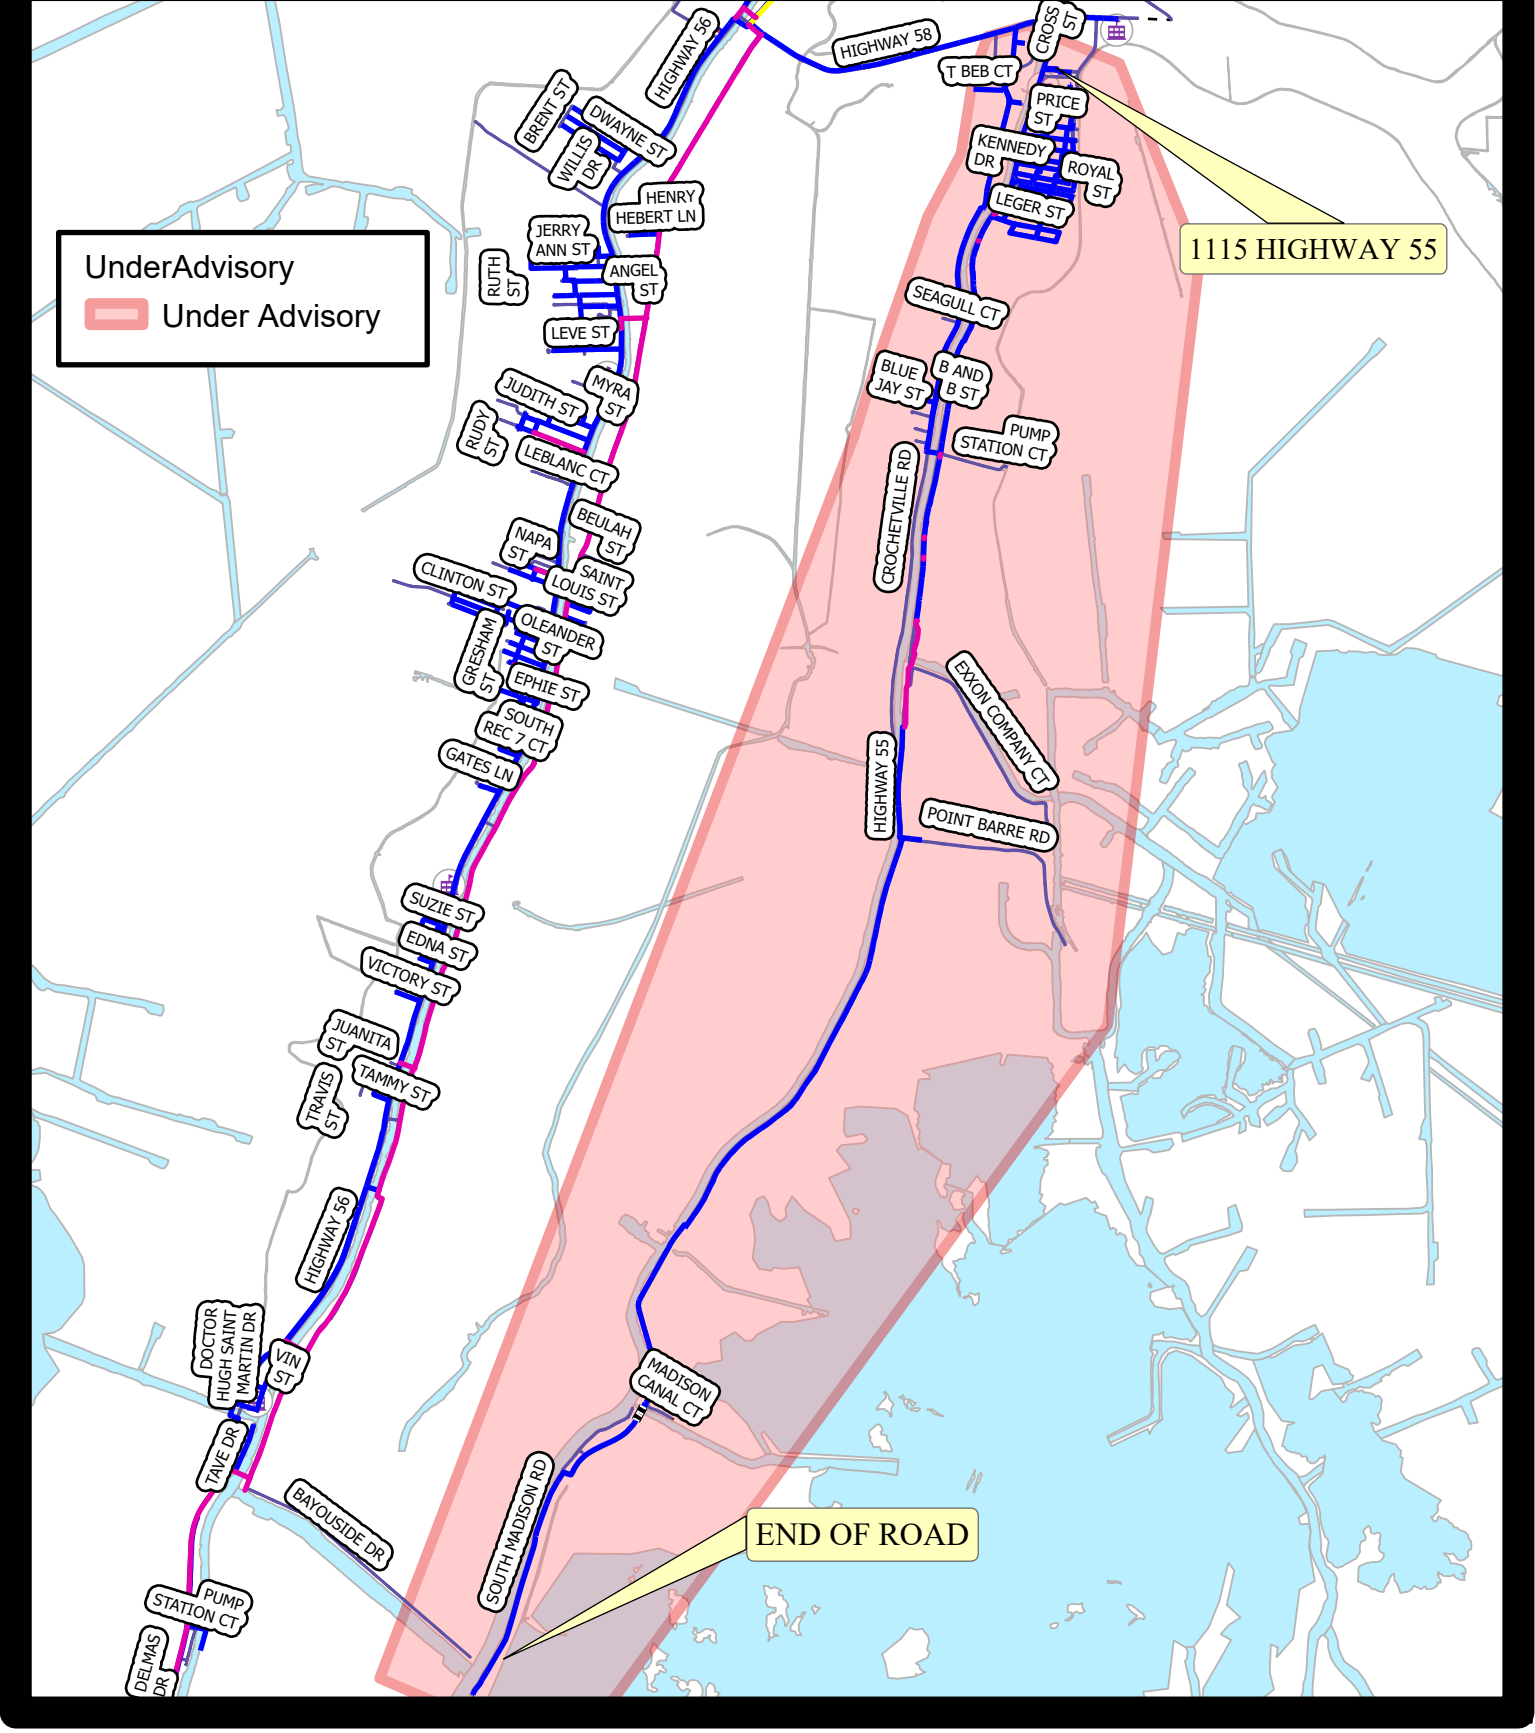

Boil Water Advisory

EST. 771 CUSTOMERS

**FROM 1115 HIGHWAY 55 TO END OF THE ROAD
 AND INCLUDING ALL OF MONTEGUT AND CROCHETVILLE RD.**



OCTOBER 25, 2022

BWA-2022-10-04

Schriever Water Treatment Plant Service Area Boil Water Advisory Report for Wednesday, October 26, 2022

Sample Location ID 1109002	Date	Chlorine Residual mg/L	Colilert P/A	Turbidity NTU
1225 Hwy 55; Montegut Post Office; POC 264	10-26-22	1.37	A	
1609 Exxon Company Ct; Humble Canal; POC 95	10-26-22	1.10	A	
2142 LA Hwy 55; Madison Canal; POC 94	10-26-22	.72	A	
2514 South Madison Rd	10-26-22	.57	A	
712 Crochetville Road; POC 93	10-26-22	1.35	A	
936 Chrochetville Rd	10-26-22	1.23	A	
1388 Hwy 665; POC 201	10-26-22	1.80	A	
2404 Hwy 665; POC 266	10-26-22	1.72	A	
2951 Hwy 665; LA Wildlife & Fisheries; POC 89	10-26-22	1.44	A	
588 Island Rd	10-26-22	1.46	A	
4260 HWY 665	10-26-22	1.68	A	
4135 Oak Pointe Rd	10-26-22	1.62	A	

Main line break caused pressure drop in the BWA affected areas

Date: October 27, 2022

Ray Percle

Ray Percle
Lab Supervisor