



CHESTER P. VOISIN
President
JOHN PIZZOLATTO
Vice-President
CLIFTON J. STOUFFLET
Secretary

STEPHEN HORNSBY
VINCENT CELESTIN
CHARLES BROWN, SR.
TERI CHATAGNIER
WILBERT THOMAS
KENNETH ELLENDER

P.O. Box 630 • Houma, LA 70361
Tel: (985) 879-2495 • Fax: (985) 879-2283

www.tpcw.org

MICHAEL A. SOBERT
General Manager

CECILIA PRADO NORMAN
Chief Administrative Officer
Jacob Prosperie, P.E.
Chief Engineer

BOIL WATER ADVISORY

October 3, 2022


BWA 2022-10-01

In accordance with the Louisiana Department of Health's Sanitary Code and out of an abundance of caution 34 metered customers from 4157 to 4204 Bayouside Drive are affected by this Boil Water Advisory. Please see the attached map for a more detailed graphic representation of the Boil Water Advisory area. Customers are advised to boil their water to a hard rolling boil for at least 1 minute prior to consumption. Please visit www.ldh.la.gov or www.tpcw.org for more specific detail information concerning what to do when a Boil Water Advisory has been issued.

A boring contractor broke the water main on requiring the water to be turned completely off to make repairs. There is the chance that water pressure may have fallen below the minimum acceptable level of 20 psi requiring this BWA. Samples will be taken today when repairs are completed, with results expected back Tuesday, 10/04/22, before 5pm..

Remember to boil your water in a hard rolling boil for at least 1 minute prior to human consumption. Please like, share, and follow us on Facebook for information concerning your drinking water supplier and the results of water quality sampling on testing of your water.

Michael A. Sobert
General Manager

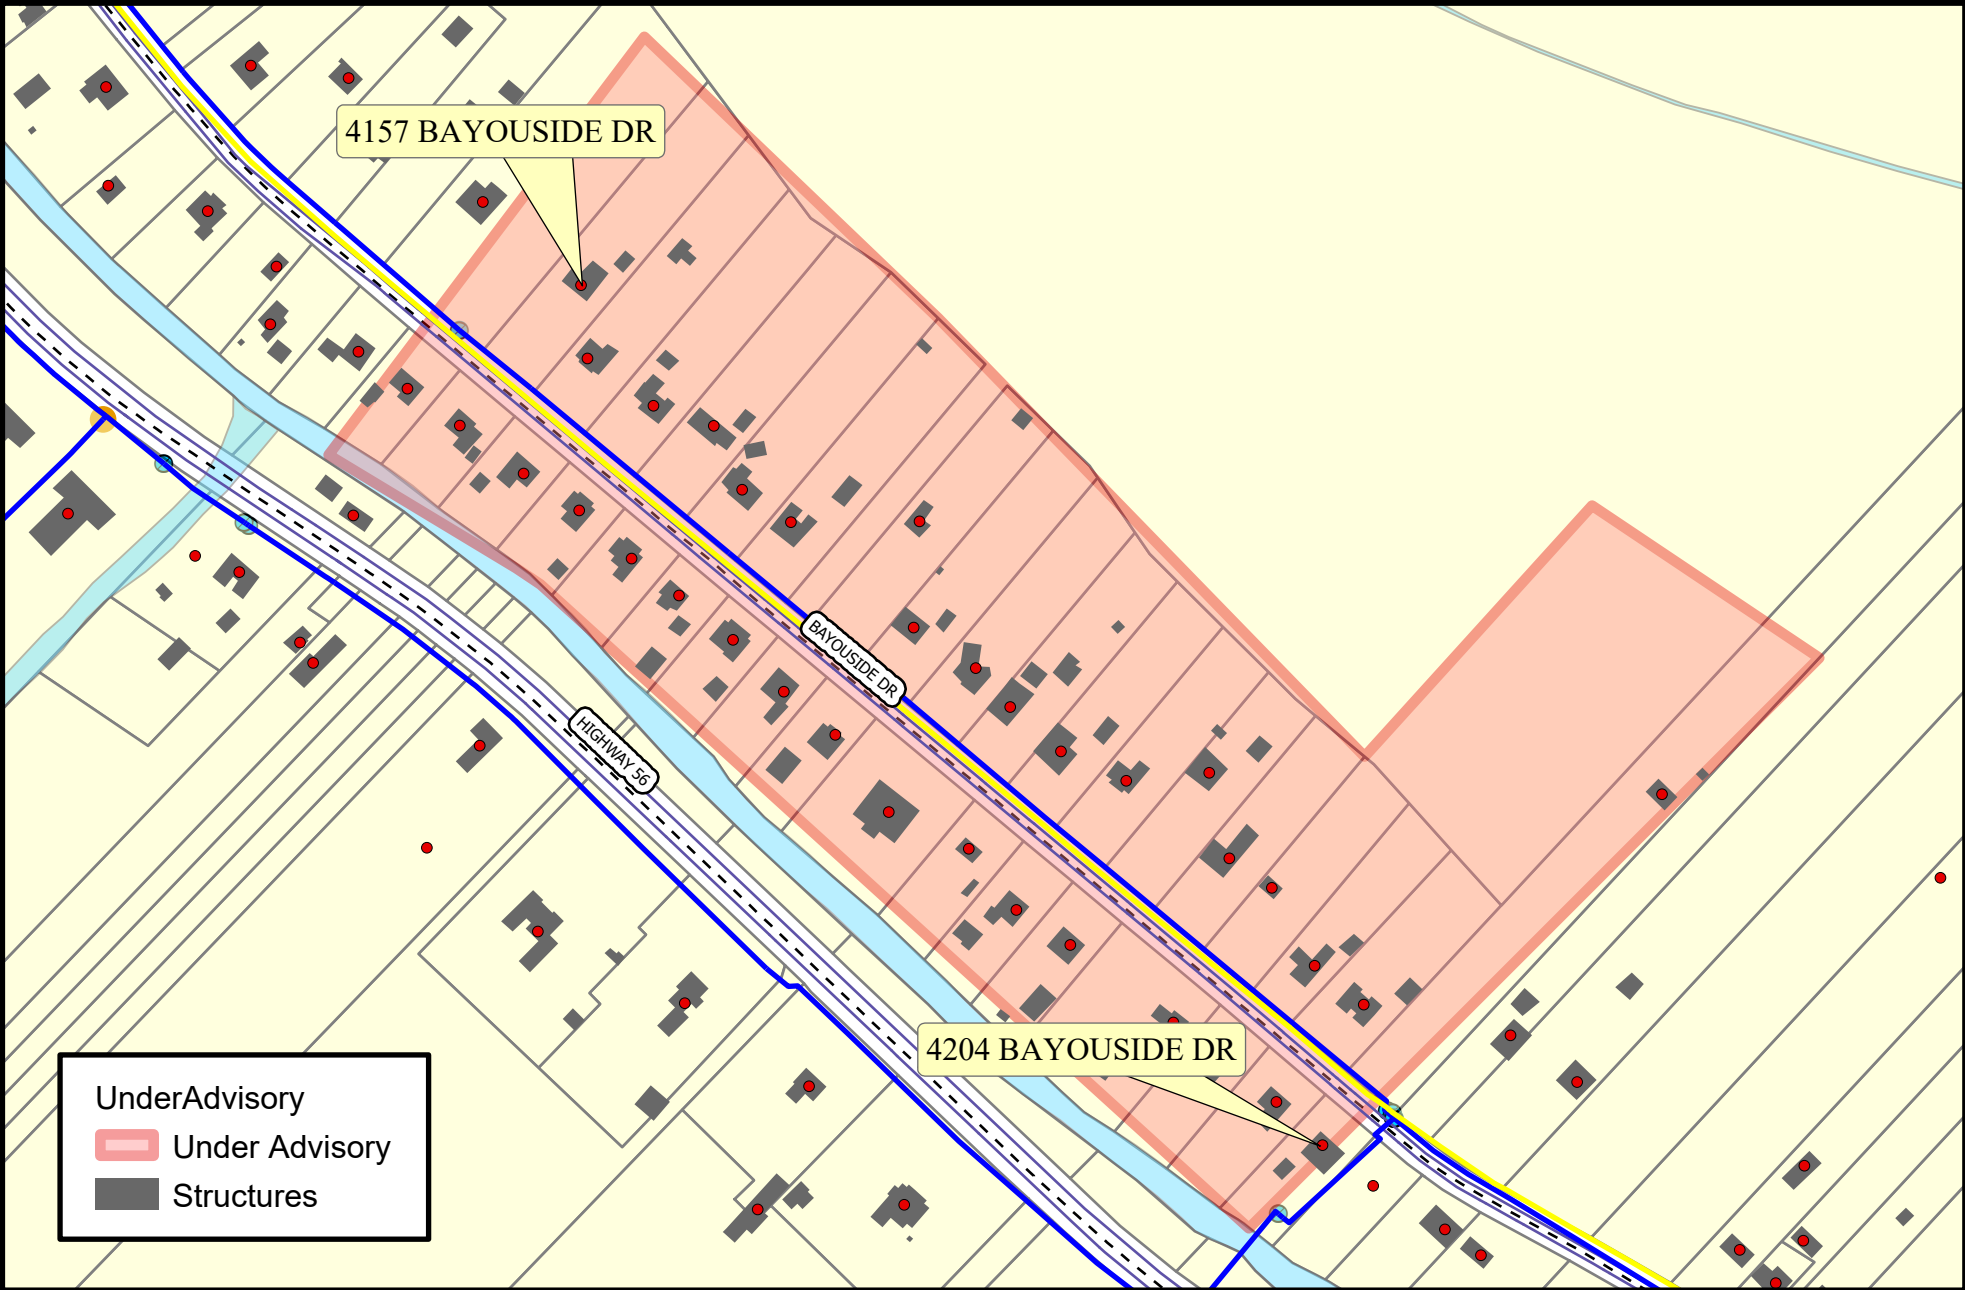

Boil Water Advisory

EST. 34 CUSTOMERS

ALL CUSTOMERS FROM
4157 BAYOUSIDE DR TO 4204 BAYOUSIDE DR

OCTOBER 3, 2022

BWA-2022-10-01

