



CHESTER P. VOISIN
President
JOHN PIZZOLATTO
Vice-President
CLIFTON J. STOUFFLET
Secretary

STEPHEN HORNSBY
VINCENT CELESTIN
CHARLES BROWN, SR.
TERI CHATAGNIER
WILBERT THOMAS
KENNETH ELLENDER

P.O. Box 630 • Houma, LA 70361
Tel: (985) 879-2495 • Fax: (985) 879-2283

www.tpcw.org

MICHAEL A. SOBERT
General Manager

CECILIA PRADO NORMAN
Chief Administrative Officer
Jacob Prosperie, P.E.
Chief Engineer

BOIL WATER ADVISORY

November 10, 2022


BWA 2022-11-02

In accordance with the Louisiana Department of Health's Sanitary Code and out of an abundance of caution 52 metered customers located on Morris St including all Filders Ct, Coach Ct, Double Ct and Single Ct are affected by this Boil Water Advisory. Please see the attached map for a more detailed graphic representation of the Boil Water Advisory area. Customers are advised to boil their water to a hard rolling boil for at least 1 minute prior to consumption. Please visit www.ldh.la.gov or www.tpcw.org for more specific detail information concerning what to do when a Boil Water Advisory has been issued.

A master meter replacement/repair in the area caused the possibility that the water pressure in the described area may have fallen below the minimum acceptable level of 20 psi requiring this BWA. Samples will be taken today with results expected back Friday, 11/11/22, before 5pm..

Remember to boil your water in a hard rolling boil for at least 1 minute prior to human consumption. Please like, share, and follow us on Facebook for information concerning your drinking water supplier and the results of water quality sampling on testing of your water.

Michael A. Sobert
General Manager

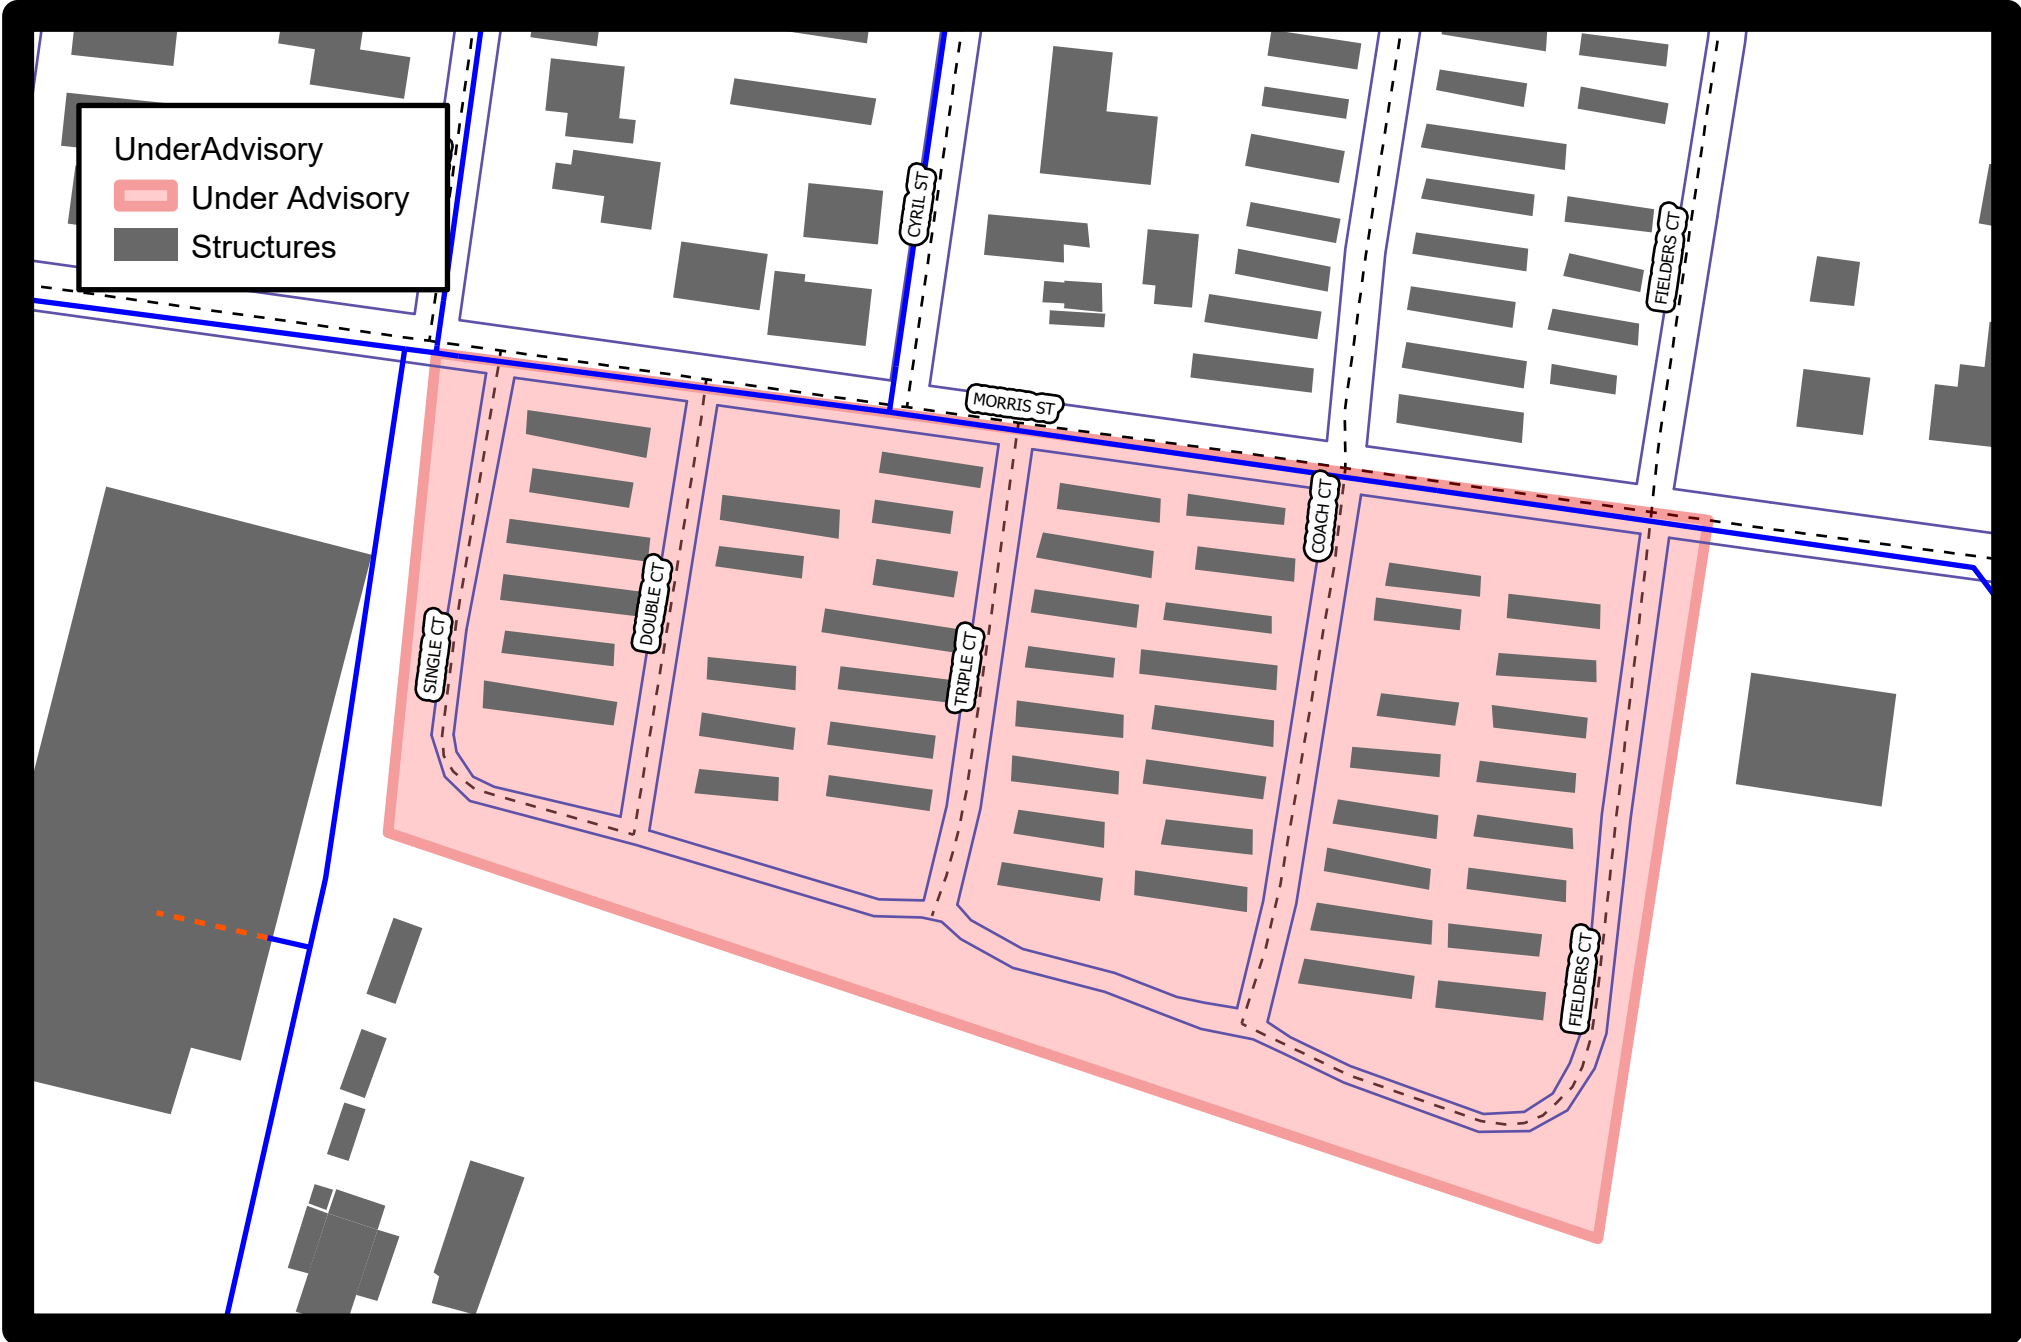

Boil Water Advisory

EST. 52 CUSTOMERS

ALONG MORRIS ST INCLUDING ALL OF FIELDS CT,
COACH CT, TRIPLE CT, DOUBLE CT AND SINGLE CT.

NOVEMBER 10, 2022

BWA-2022-11-02

