

Schriever Water Treatment Plant Service Area Boil Water Advisory Report for Tuesday, December 20, 2022


Sample Location ID 1109002	Date	Chlorine Residual mg/L	Colilert P/A	Turbidity NTU
1609 Exxon Company Ct; Humble Canal; POC 95	12-20-22	1.30	A	0.39
2142 LA Hwy 55; Madison Canal; POC 94	12-20-22	1.11	A	0.7
2514 South Madison Rd	12-20-22	.71	A	0.68

Broken valve during Hydrant replacement required water being shut off to the BWA area.

Date: 12-21-22

Ray Percle

Ray Percle
Lab Supervisor

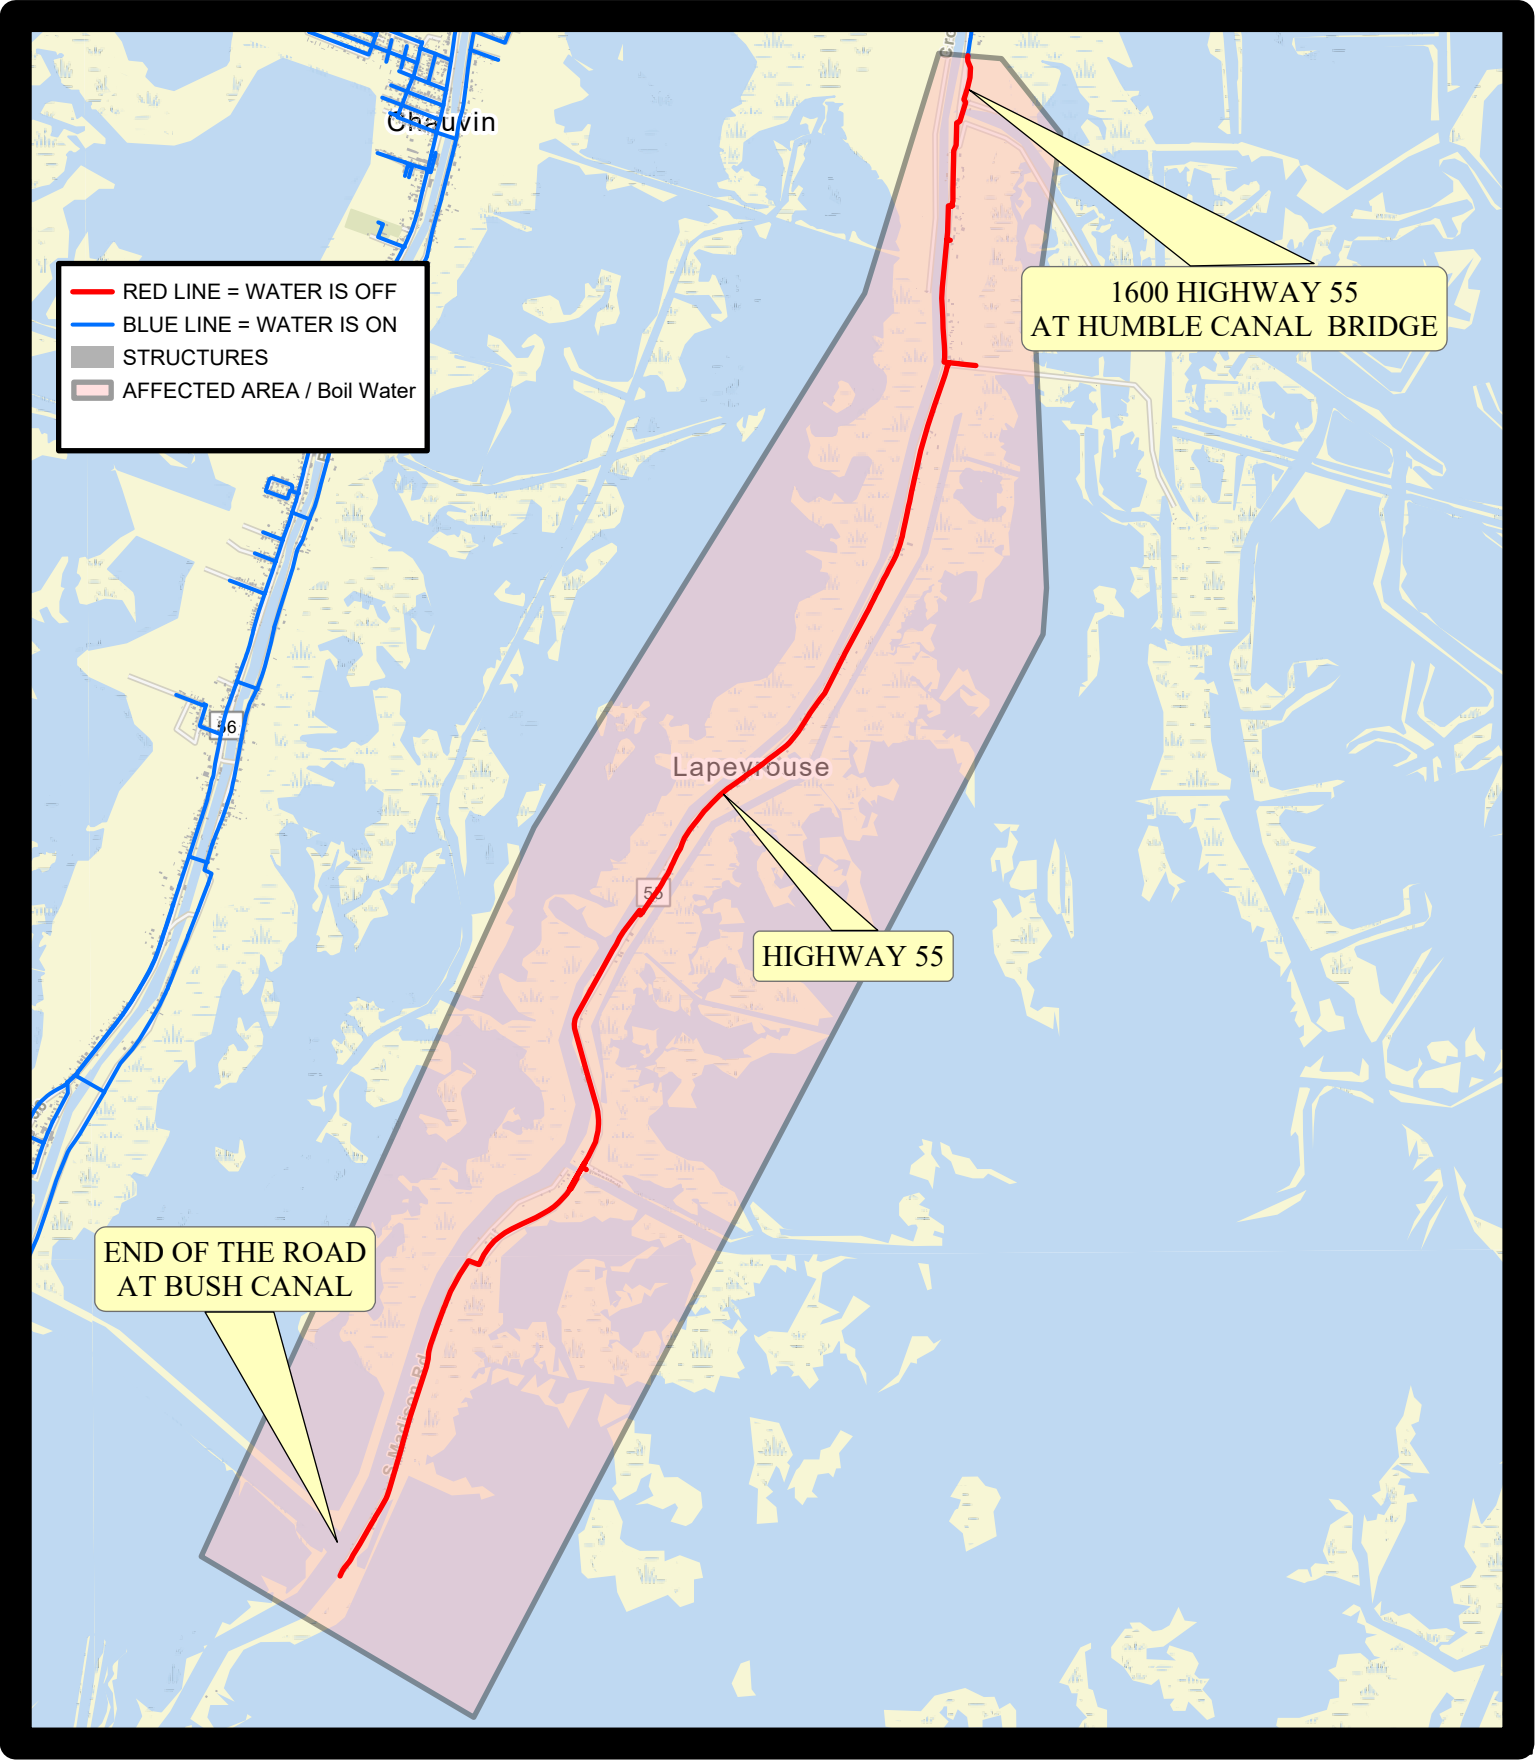

Boil Water Advisory

EST. 193 CUSTOMERS

**FROM HUMBLE CANAL BRIDGE SOUTH
TO THE END OF ROAD AT BUSH CANAL**



DECEMBER 19, 2022

BWA-2022-12-03